



Wood Environment & Infrastructure Solutions, Inc
 200 American Metro Blvd., Suite 113
 Hamilton, NJ 08619
 Phone: (609) 689-2829 Fax: (609) 689-2838

LETTER OF TRANSMITTAL

TO: Allan Williams Highland Park Environmental Commission FROM: John Poserina, Project Manager	DATE: 09/10/2018 PROJECT NO.: 3480180606 PROJ. NAME: Honeywell Highland Park SUBJECT: Construction Air Monitoring Data for week of 082018 to 082418 Former Midland Ross Facility, SRP PI#018773 Highland Park, New Jersey
---	--

WE TRANSMIT TO YOU: HEREWITH UNDER SEPARATE COVER

SUBJECT:

- DRAWINGS
- SPECIFICATIONS
- CALCULATIONS
- REPORT
- COST ESTIMATE
- AS NOTED

ACTION:

- FOR YOUR INFORMATION
- FOR YOUR COMMENT OR APPROVAL
- RETURNED FOR CORRECTION: RESUBMIT
- APPROVED AS NOTED
- AS REQUESTED

SENT BY:

- MAIL
- CERTIFIED MAIL
- EXPRESS **Federal Express**
- COURIER
- HAND DELIVERED
- FACSIMILE:

36 pages (including transmittal sheet)

COPIES	DATE	DESCRIPTION
1	08/24/18	Construction Air Monitoring Data

REMARKS:

The following data package includes the following from the week of 082018 to 082418

- Map displaying Air Monitoring Station locations
- Dust Monitoring Results
- Laboratory Air Sample Results

CC: Maria Kaouris - Honeywell
Jorge Berkowitz, Ph.D, LSRP - Langan
Kay Licausi

By: John Poserina, P.E.


 Direct Phone: (609) 631-2923

CONFIDENTIALITY NOTICE: This message is intended only for the use of the individual or entity to which it is addressed, and may contain information that is privileged, confidential, and exempt from disclosure under applicable law. If the reader of this message is not the intended recipient, or the employee or agent responsible for delivering the message to the intended recipient, you are hereby notified that any dissemination, distribution, or copying of this communication is strictly prohibited. If you have received this communication in error, please notify us immediately by telephone and return the original message to us at the above address via the U.S. Postal Service. Thank you.

If transmission is not received in good order, please call Project Coordinator at (610) 828-8100.


AIR MONITORING STATION LOCATIONS

UNLESS OTHERWISE AGREED IN A WRITTEN CONTRACT BETWEEN WOOD AND ITS CLIENT, (i) THIS DOCUMENT CONTAINS INFORMATION, DATA AND DESIGN THAT IS CONFIDENTIAL AND MAY NOT BE COPIED OR DISCLOSED, AND (ii) THIS DOCUMENT MAY ONLY BE USED BY THE CLIENT IN THE CONTEXT AND FOR THE EXPRESS PURPOSE FOR WHICH IT HAS BEEN DELIVERED. ANY OTHER USE OR RELIANCE ON THIS DOCUMENT BY ANY THIRD PARTY IS AT THAT PARTY'S SOLE RISK AND RESPONSIBILITY.

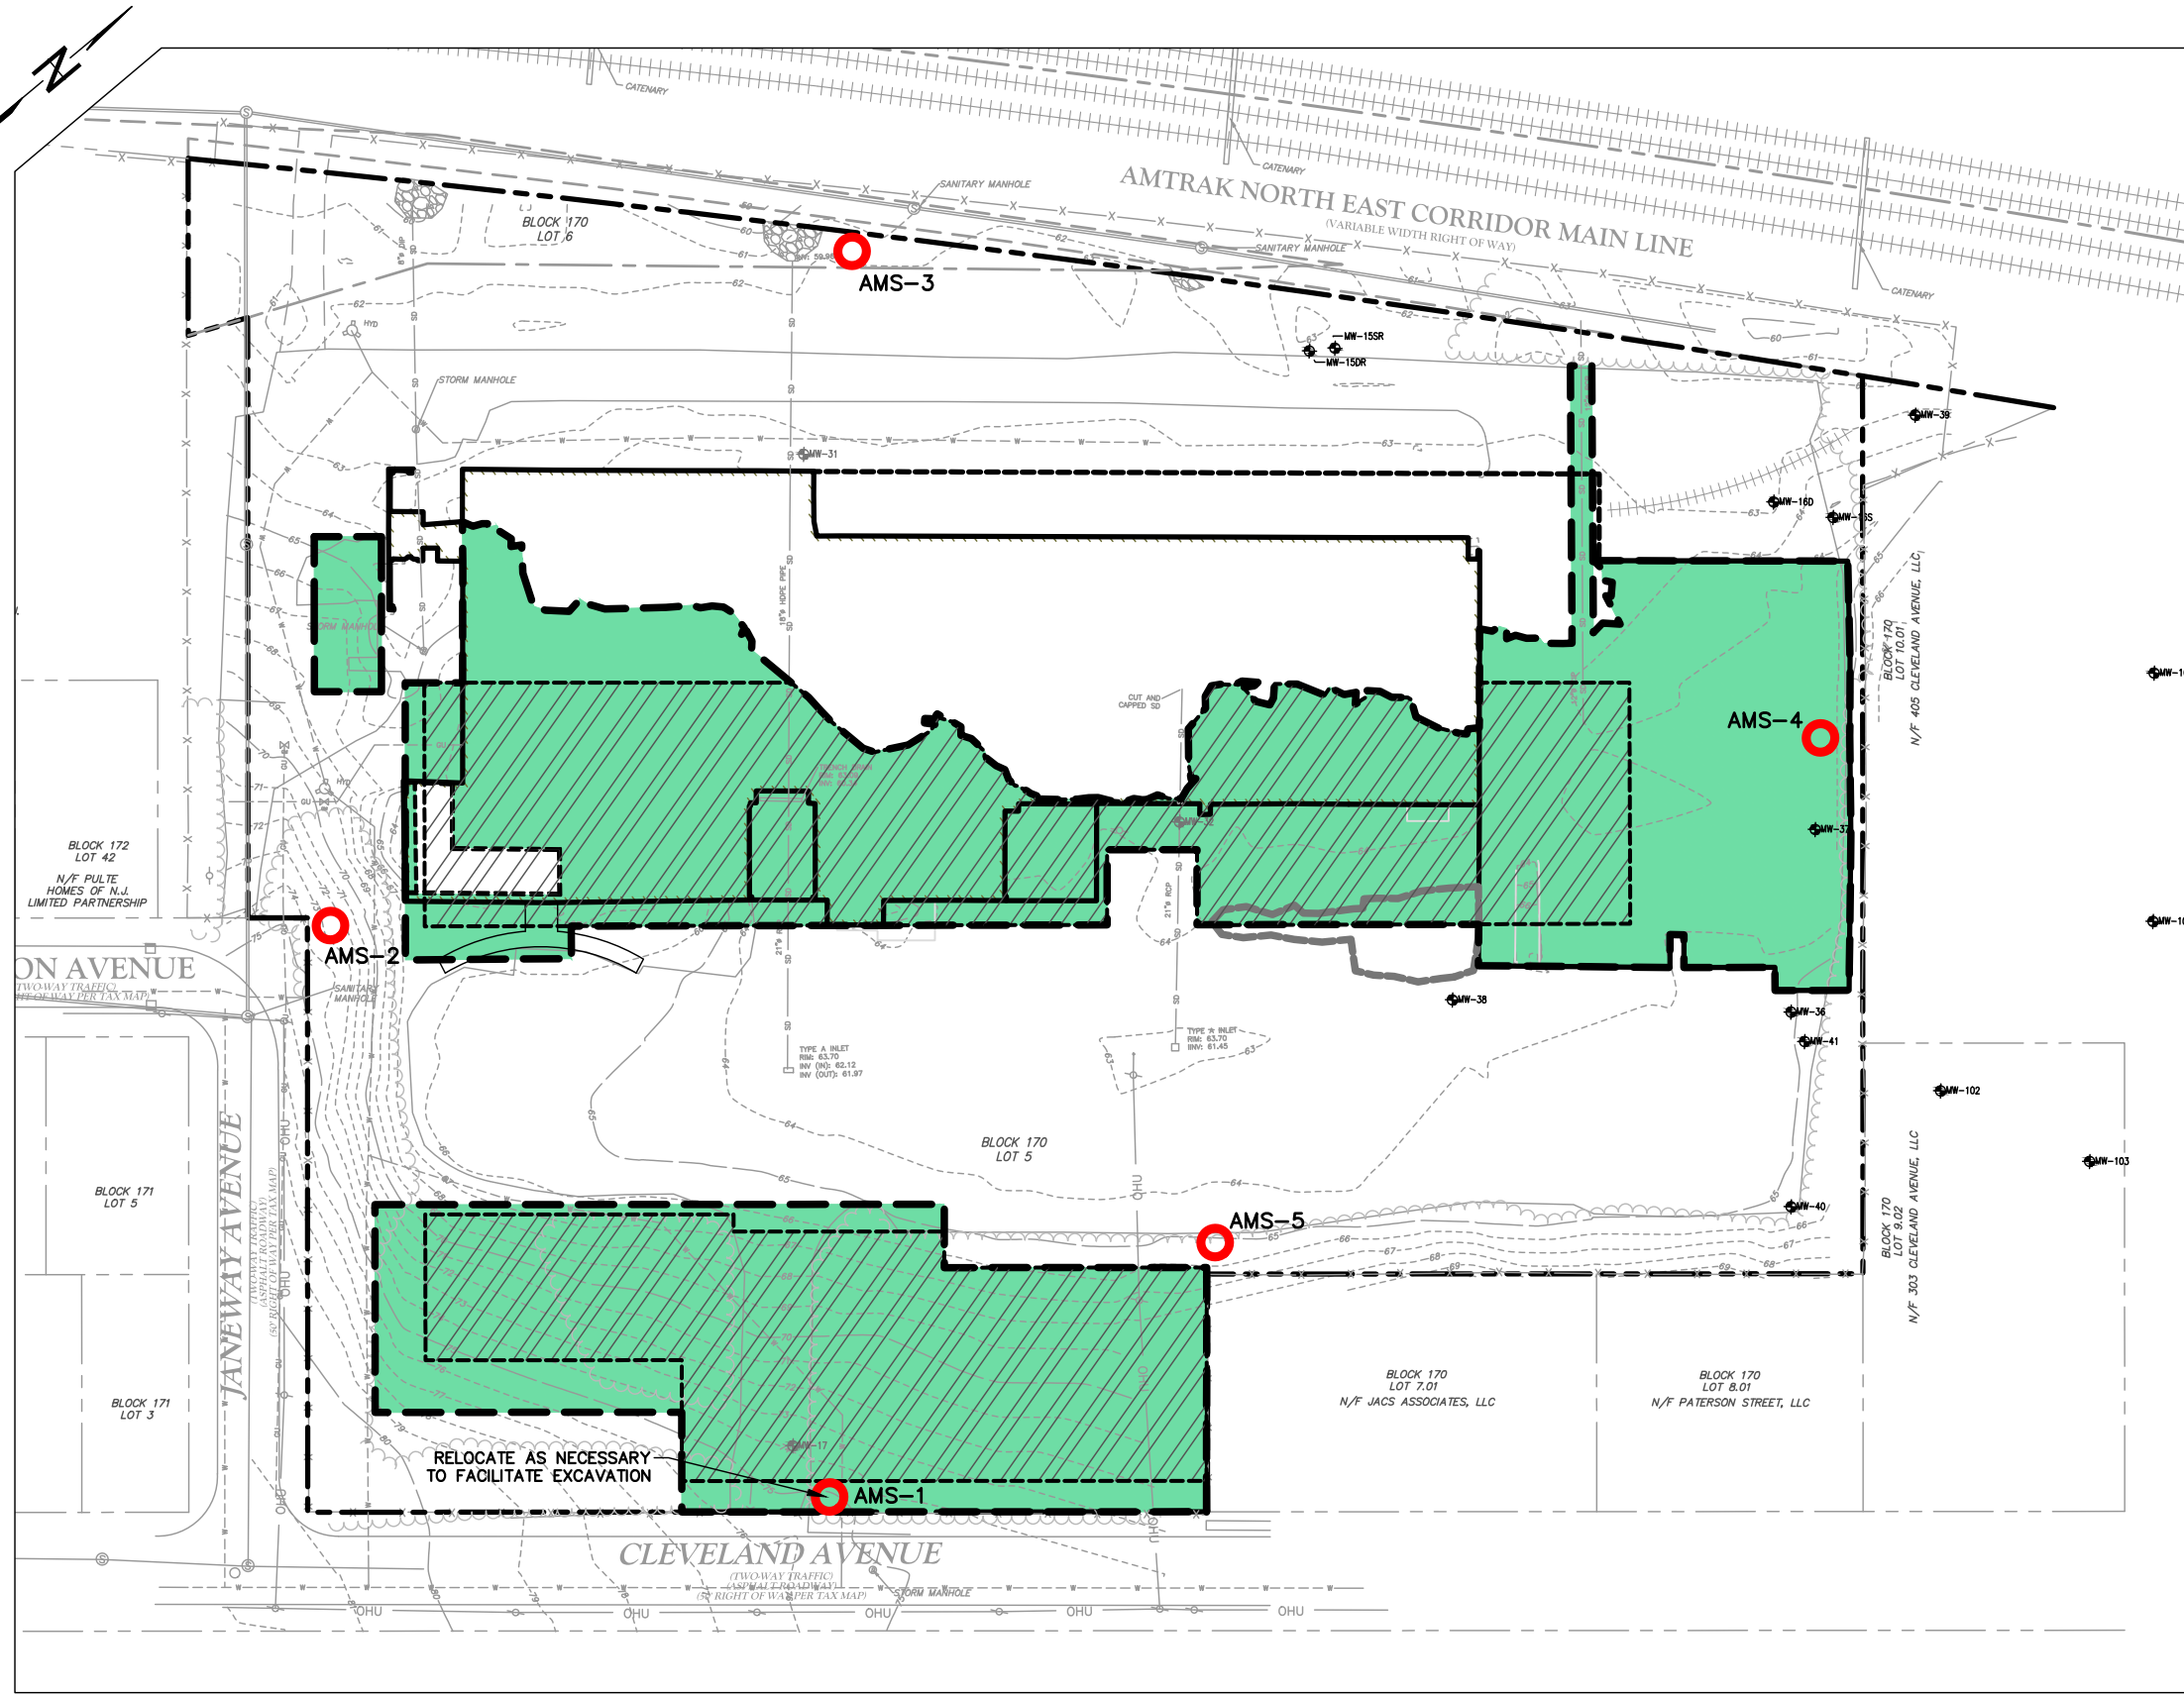

LEGEND:

- PROPERTY BOUNDARY (FORMER MIDLAND-ROSS FACILITY)
- PROPOSED EXCAVATION AREA (AOC MR-8)
- FORMER JANEWAY-CARPENTER BUILDING CONCRETE SLAB REMOVAL AREA
- AMS-1 PROPOSED AIR MONITORING STATION LOCATION



SOURCE MAP REFERENCE:
DRAWING TITLED "TOPOGRAPHIC SURVEY, BLOCK 170, LOTS 5 & 6, BOROUGH OF HIGHLAND PARK, COUNTY OF MIDDLESEX, STATE OF NEW JERSEY" DATED 1/9/2017 BY MASER CONSULTING P.A., MOUNT ARLINGTON, NEW JERSEY, PROJECT NUMBER 16001990A

REV.	DATE	STATUS	PRPD BY	CHKD BY

WOOD PROJECT No. 3480170577
DRAWING: 3480170577-5200-RA00-0000

PREPARED/DATE:
VMW 09/29/17

CHECKED/DATE:
US 09/29/17

wood.

ENVIRONMENT & INFRASTRUCTURE SOLUTIONS
200 AMERICAN METRO BLVD, SUITE 113
HAMILTON, NEW JERSEY 08619

FIGURE 1
PROPOSED PERIMETER AIR MONITORING STATION LOCATION
HONEYWELL - FORMER MIDLAND-ROSS SITE
HIGHLAND PARK, NEW JERSEY

**QUICK REFERENCE ACTION RESPONSE
TABLE FROM PERIMETER AIR
MONITORING PLAN**

Quick Reference Action Response Plan
Former Midland Ross Facility
Highland Park, NJ



Quick Reference Action Response Plan

Acute Dust _{PM-10} Action Level	Action/Procedure
$\geq 109 \text{ ug/m}^3 + \text{Background}$ (duration of less than 5 minutes)	<ul style="list-style-type: none"> • The PAMPT will observe PM-10 concentrations at the location of the exceedance. Make notification to SHSO. The PAMT and SHSO will attempt to identify the source of the PM-10 emissions. The SHSO will make preparations to address the source. • Continue to observe PM-10 emissions.
$\geq 109 \text{ ug/m}^3 + \text{Background}$ (duration of more than 5 minutes)	<ul style="list-style-type: none"> • Document the time and PM-10 level within the air monitoring log or field log book. Prepare to collect confirmatory sample. • Implement use of engineering control measures if PM is sustained above 109 ug/m^3 for more than 5 minutes. • Continue to observe PM-10 emissions.
$\geq 109 \text{ ug/m}^3 + \text{Background}$ (duration of more than 15 minutes)	<ul style="list-style-type: none"> • Cease intrusive activities. Document the time and PM-10 level within the air monitoring log or field log book. • Collect confirmatory sample. • Re-evaluate work procedures and amend as appropriate. Continue monitoring and engineering control measures. • When PM-10 concentration falls below the Action Level (15 minute TWA), work may resume.
Visible dust	<ul style="list-style-type: none"> • Implement dust suppression measures (discretion of the PAMT).

CONSTRUCTION AIR MONITORING DATA



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 1 8/20/2018**

Air Monitoring Results

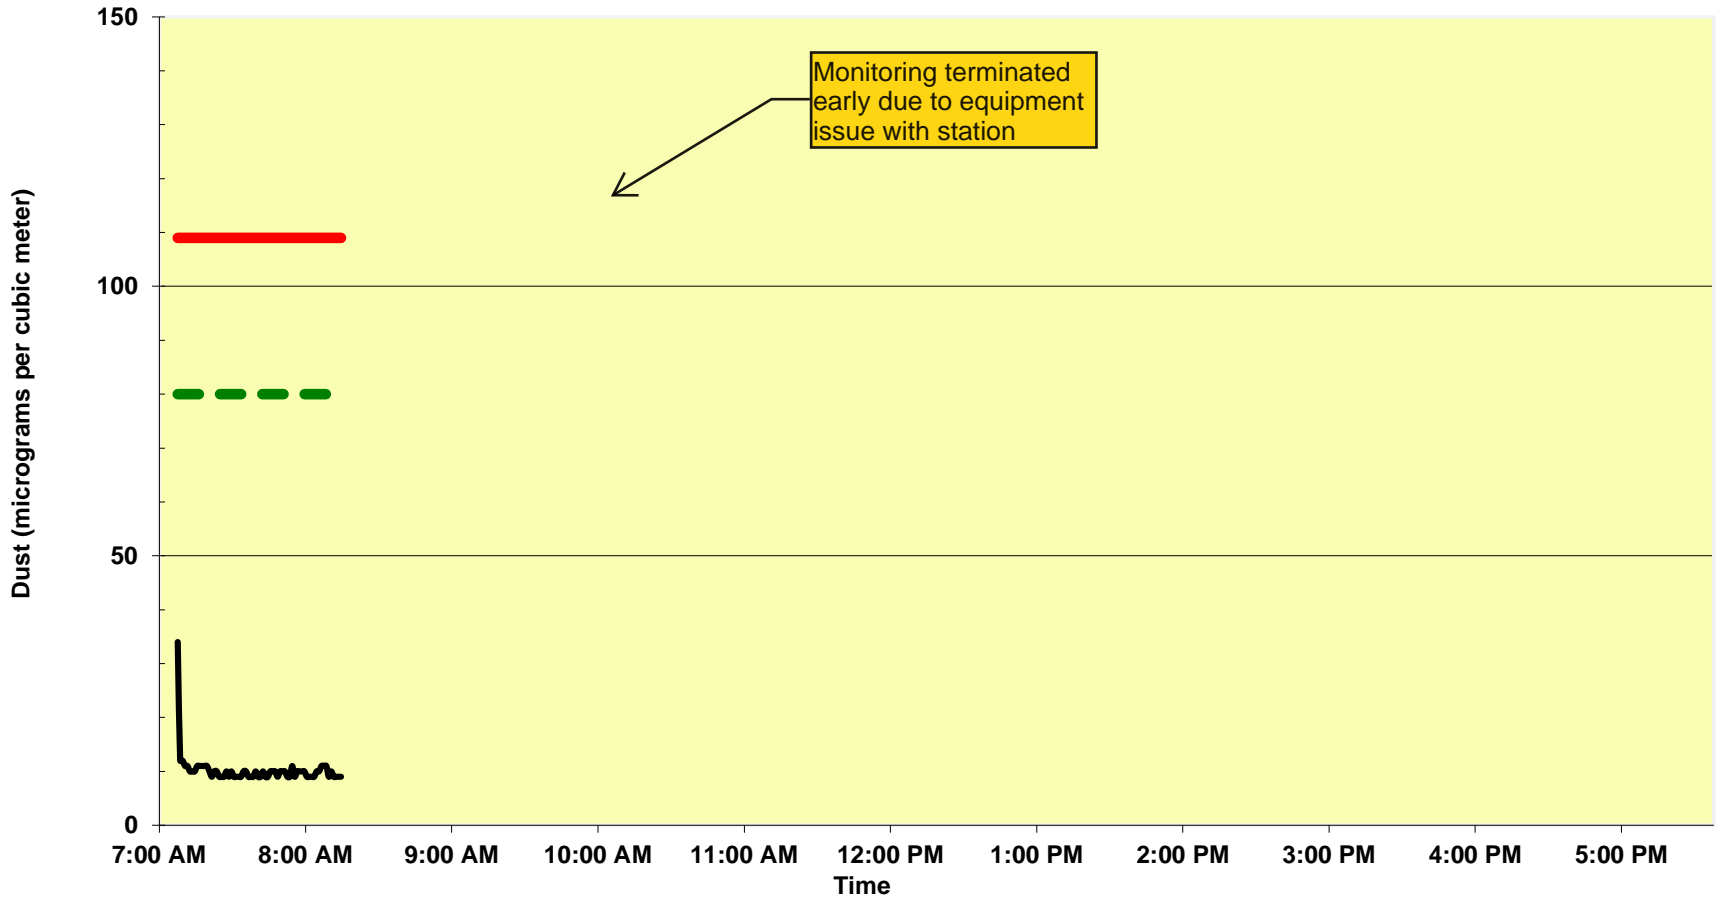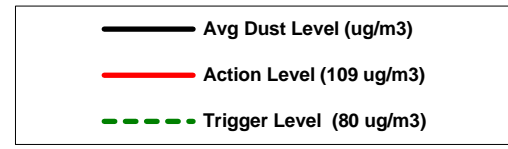



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 2 8/20/2018**

Air Monitoring Results

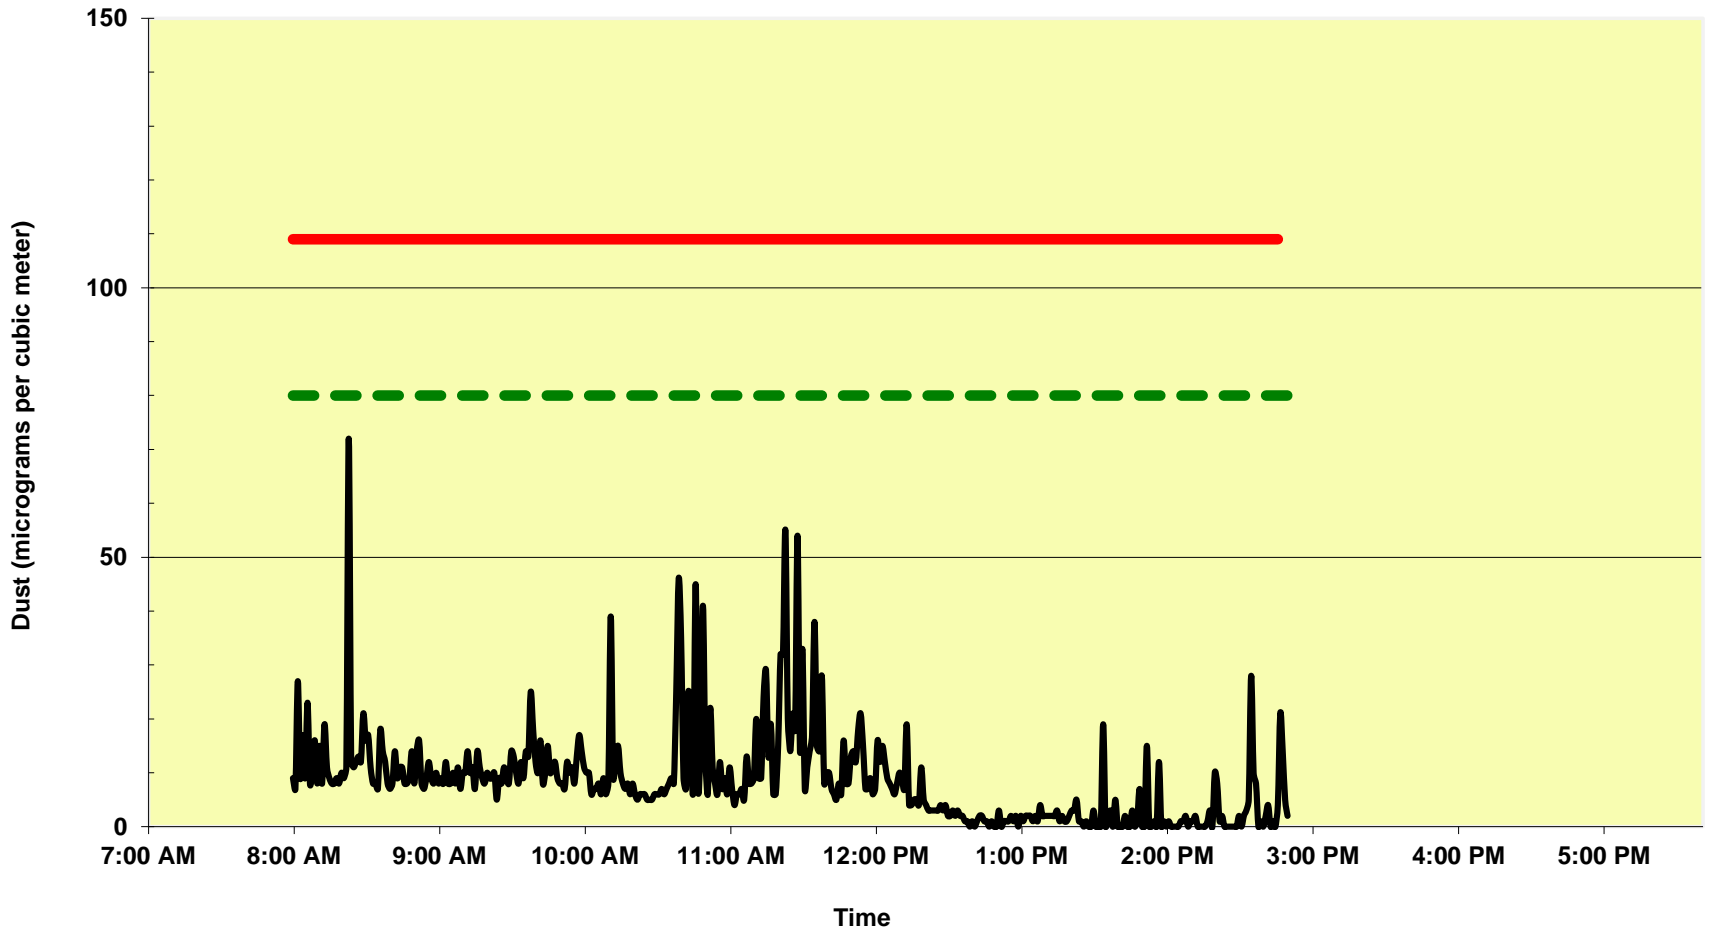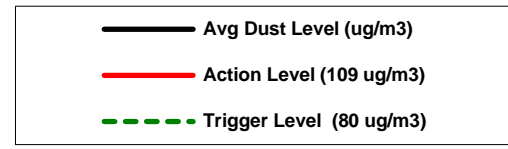



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 3 8/20/2018**

Air Monitoring Results

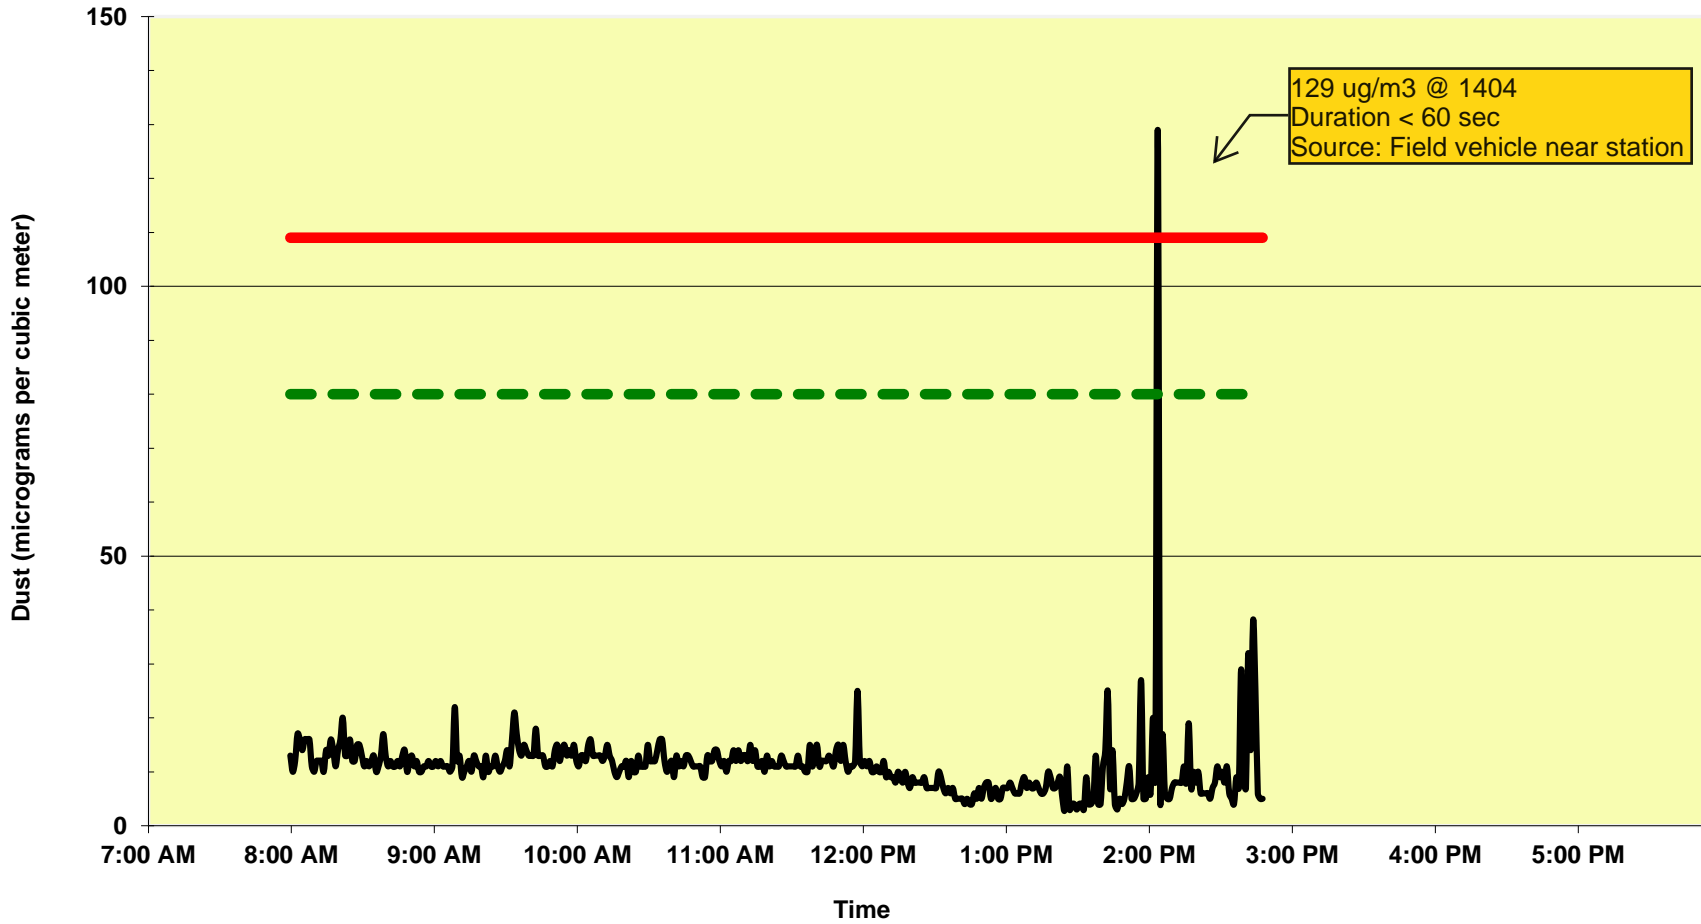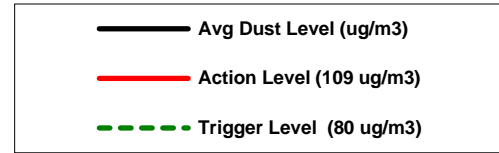



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 4 8/20/2018**

Air Monitoring Results

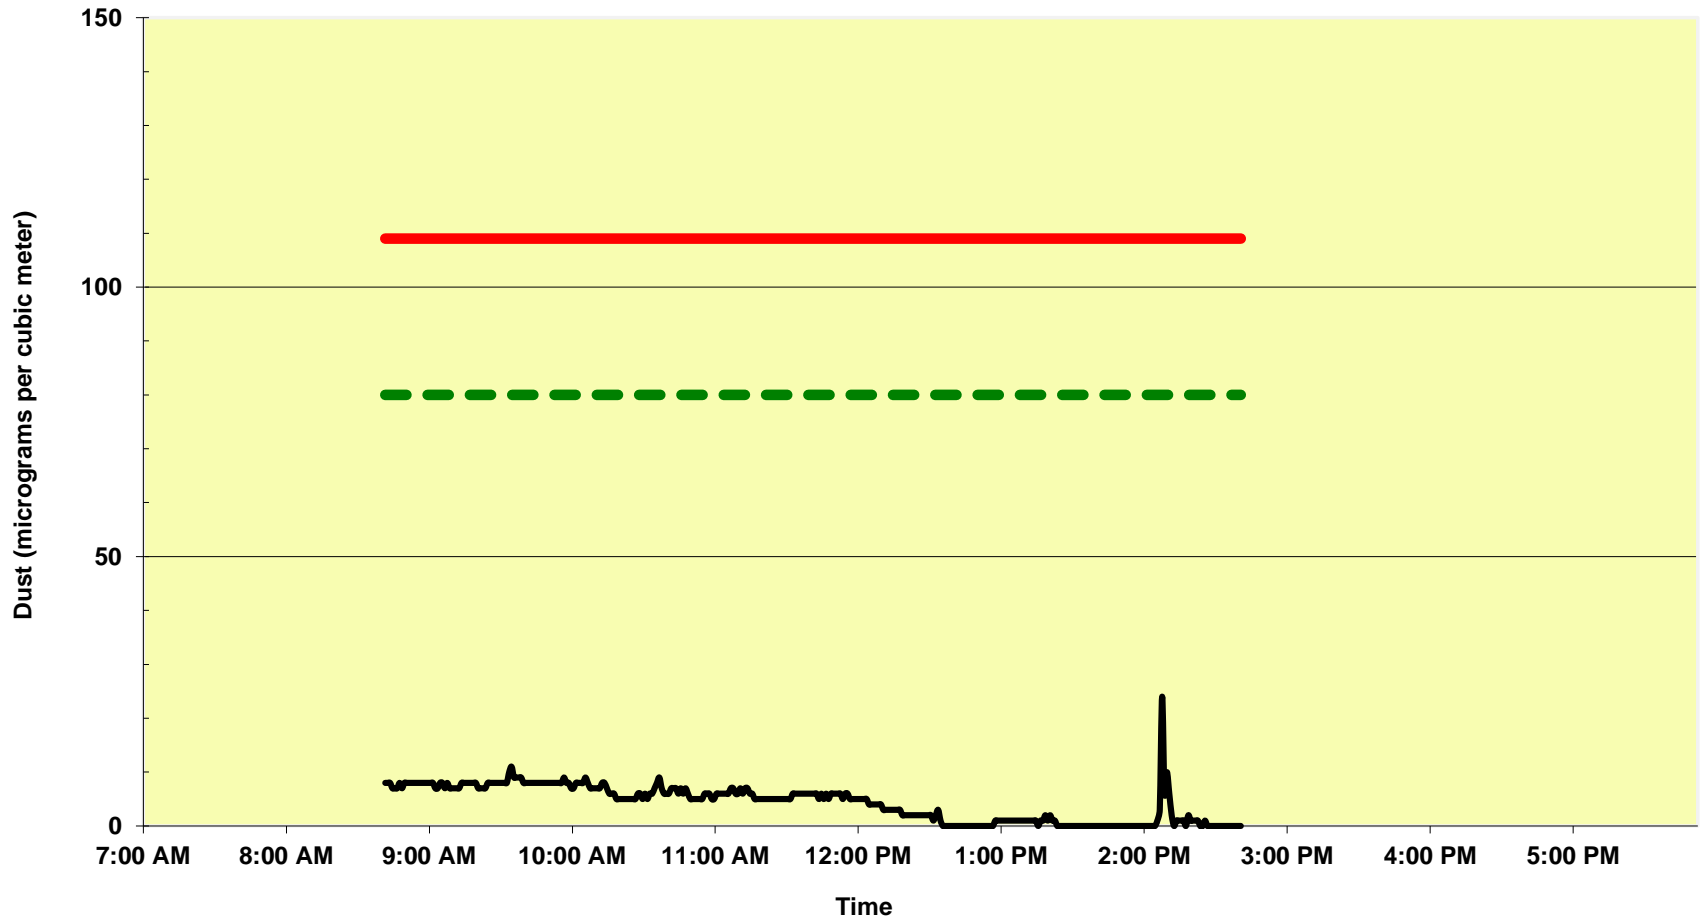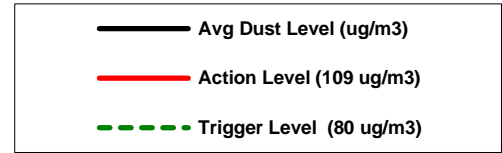



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 5 8/20/2018**

Air Monitoring Results

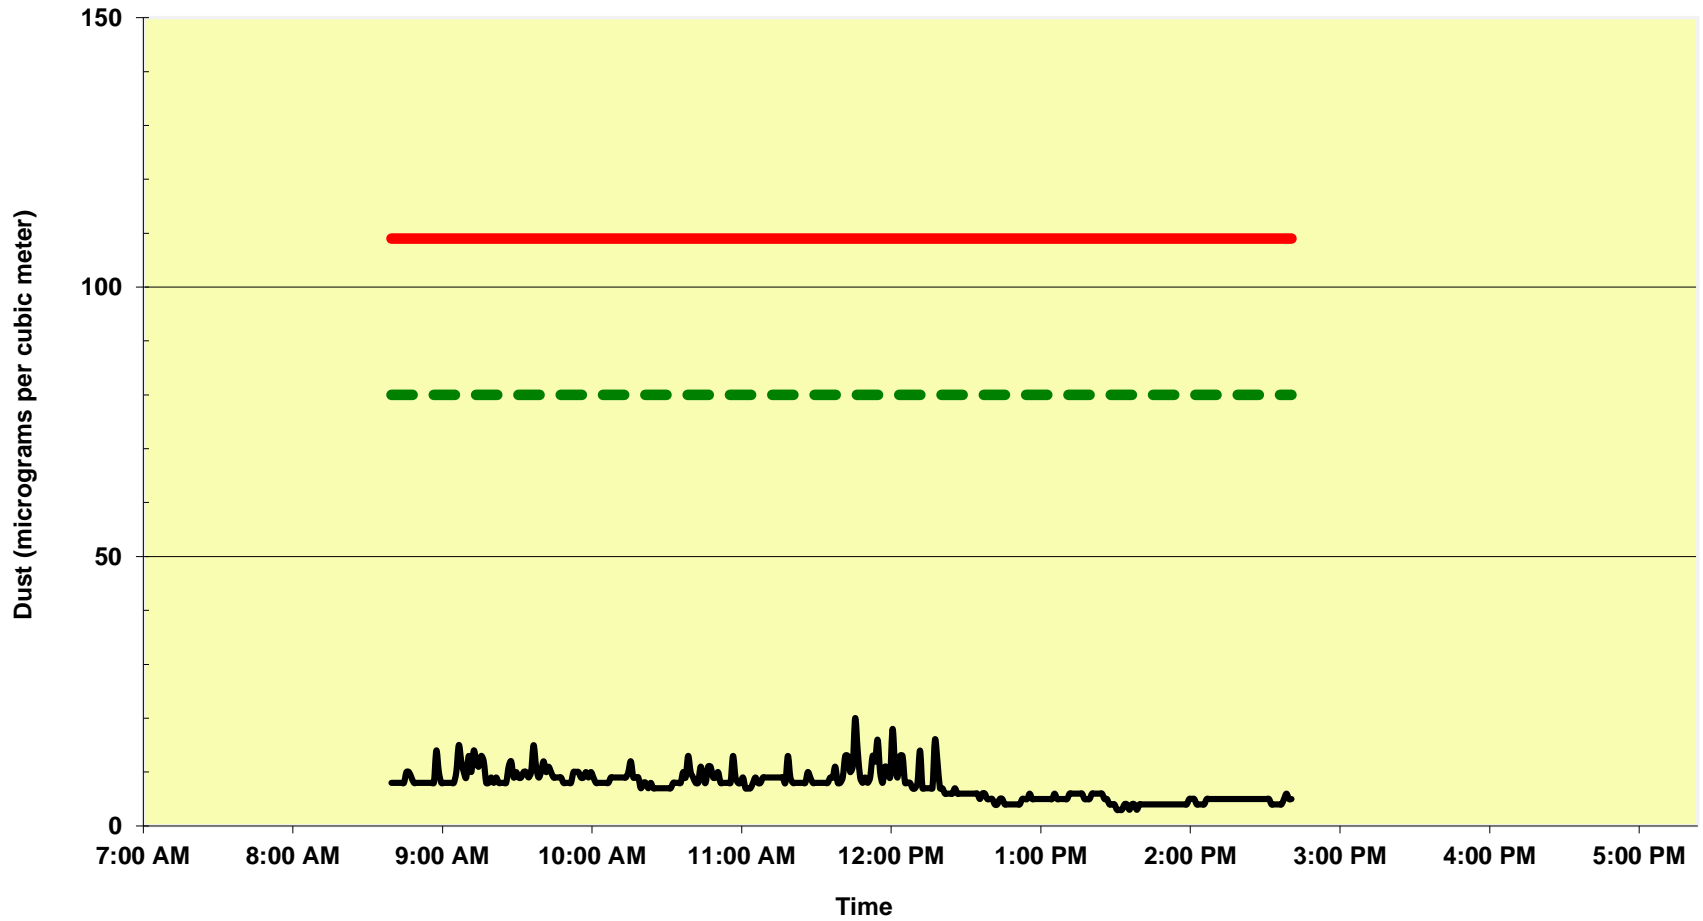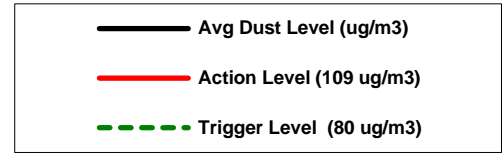



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 1 8/21/2018**

Air Monitoring Results

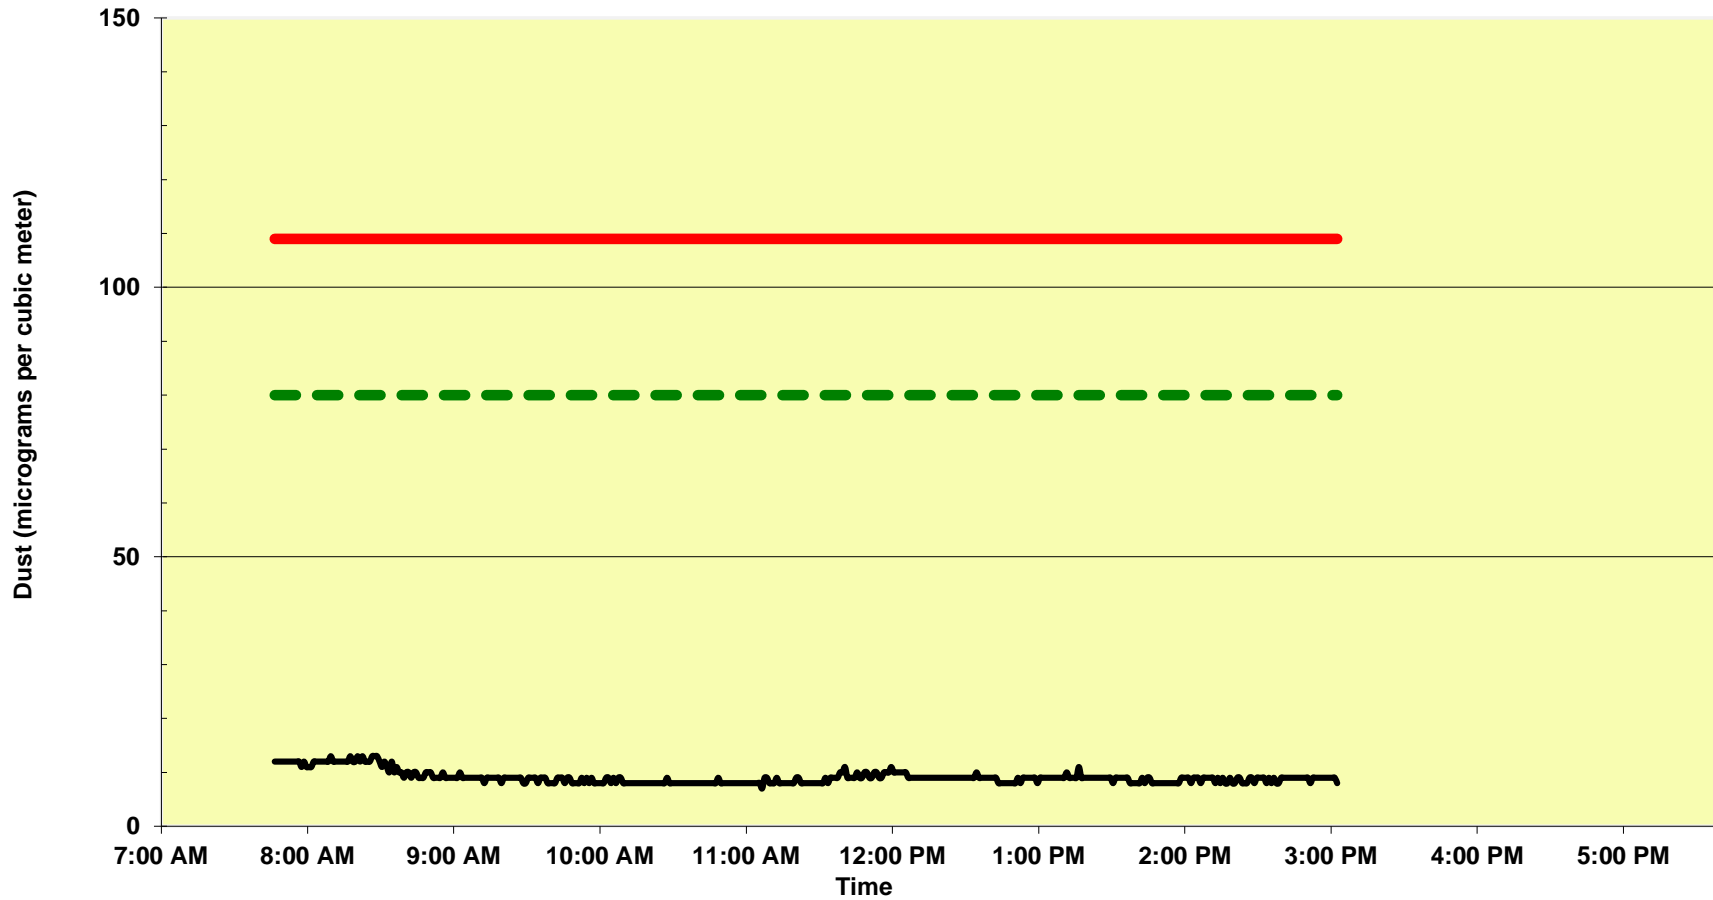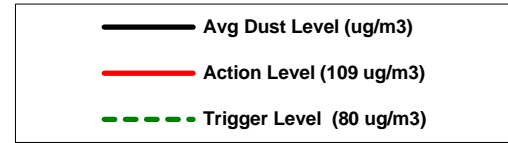



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 2 8/21/2018**

Air Monitoring Results

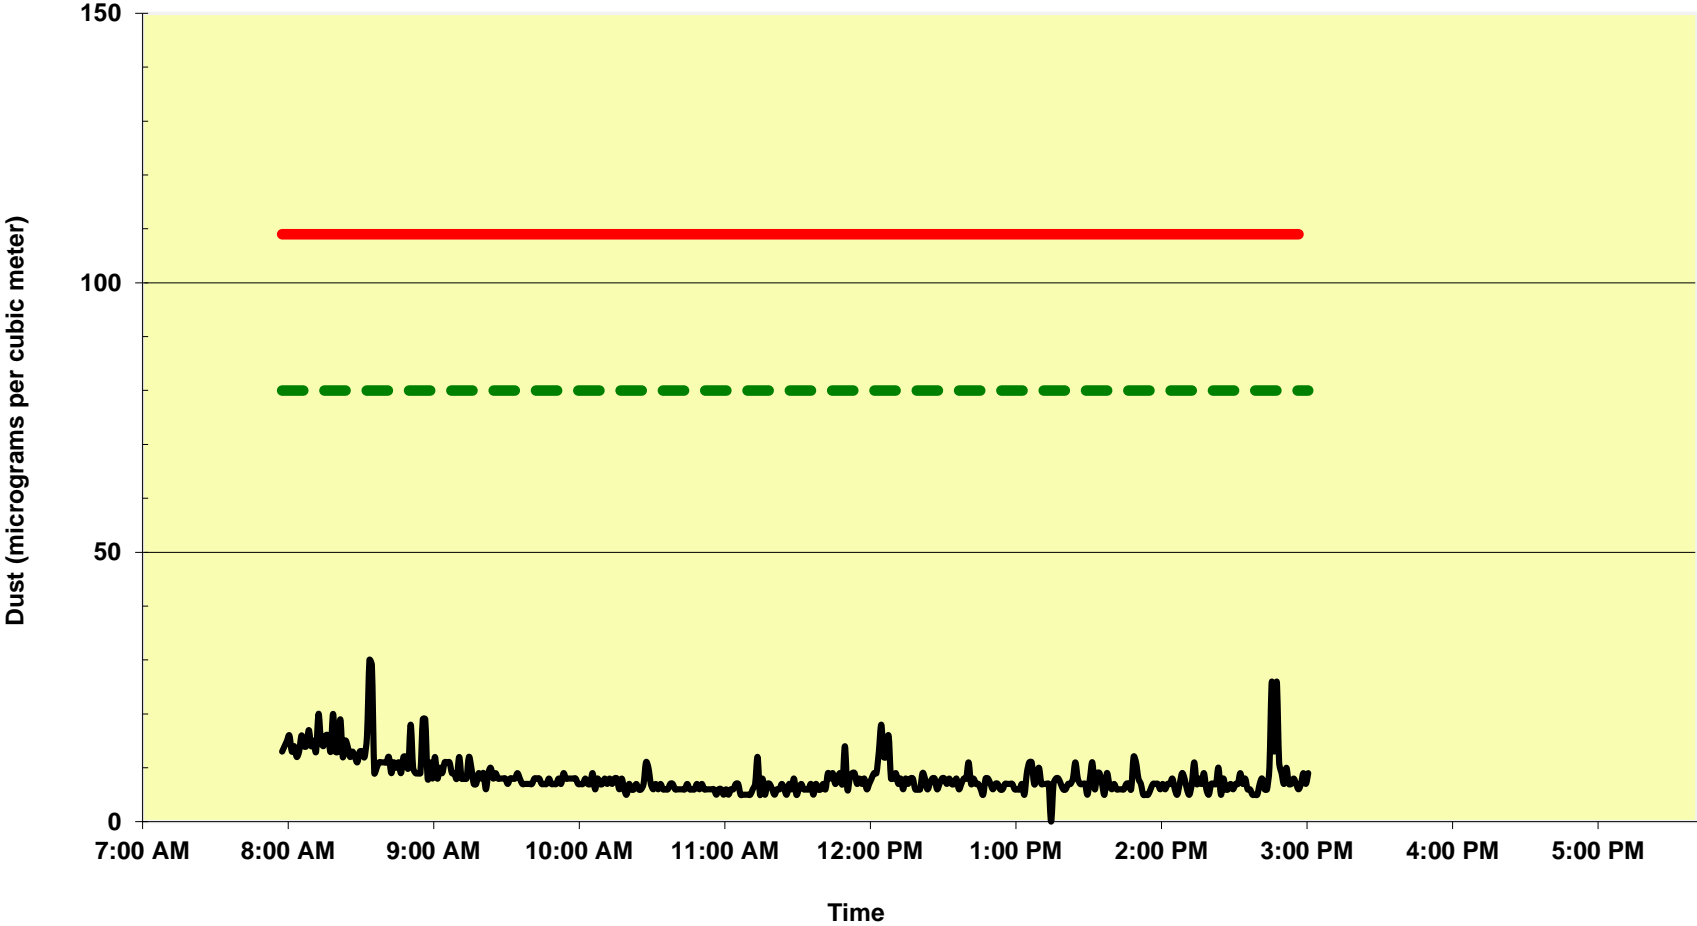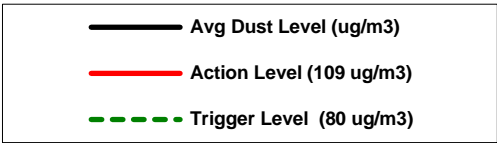



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 3 8/21/2018**

Air Monitoring Results

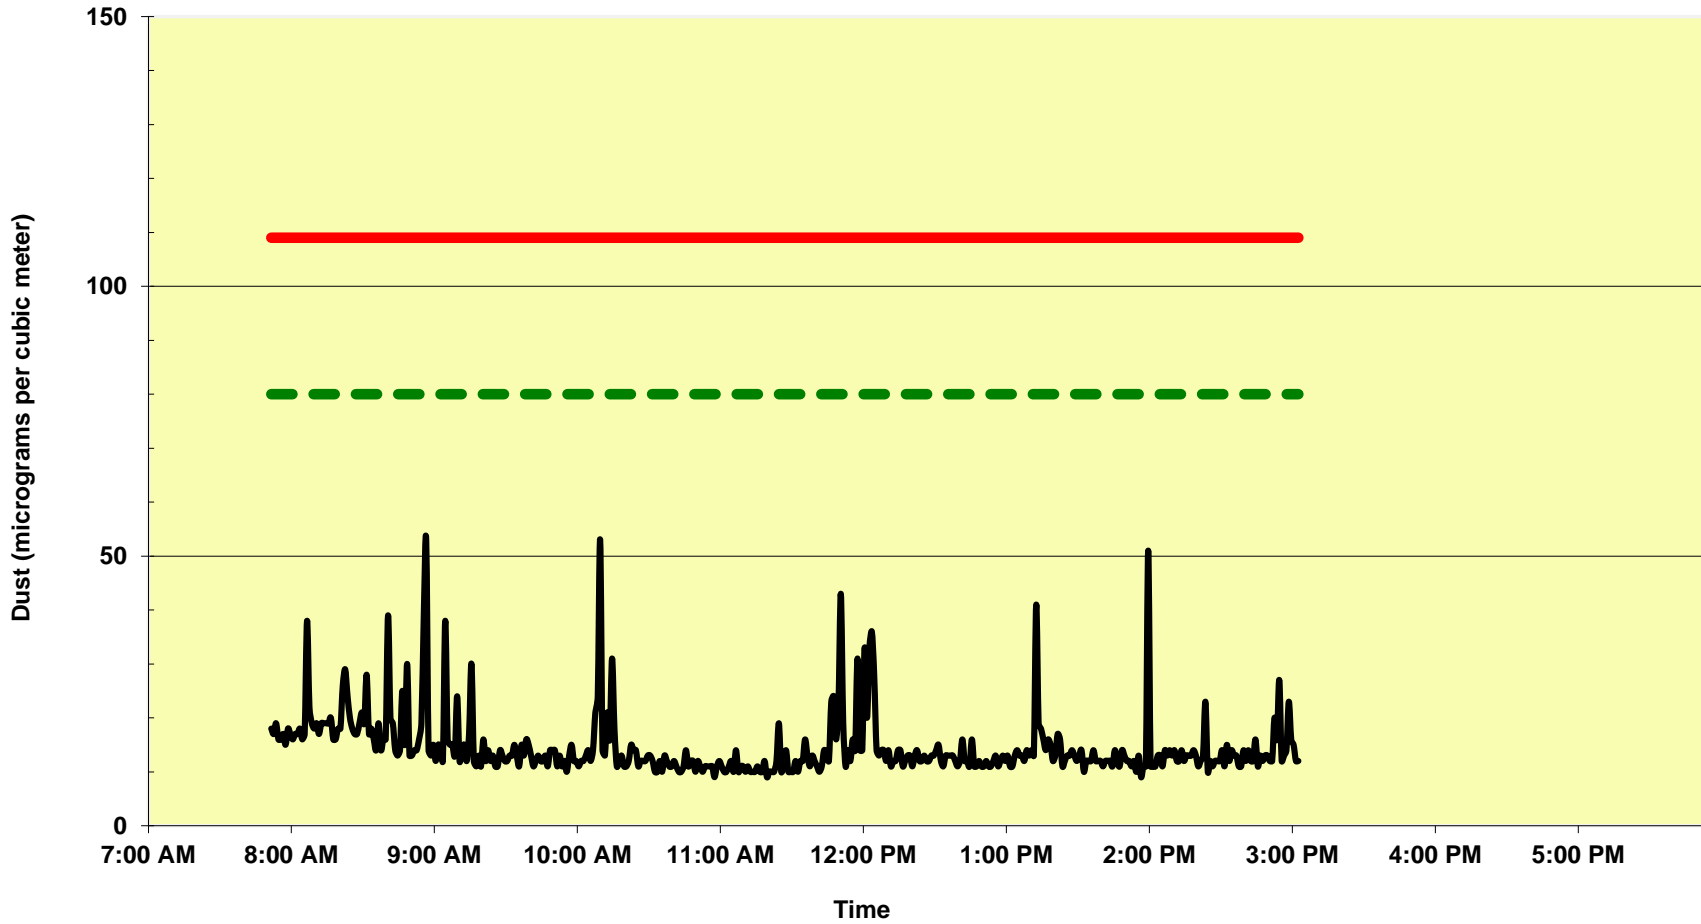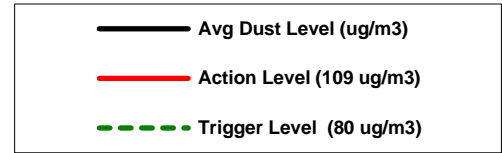



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 4 8/21/2018**

Air Monitoring Results

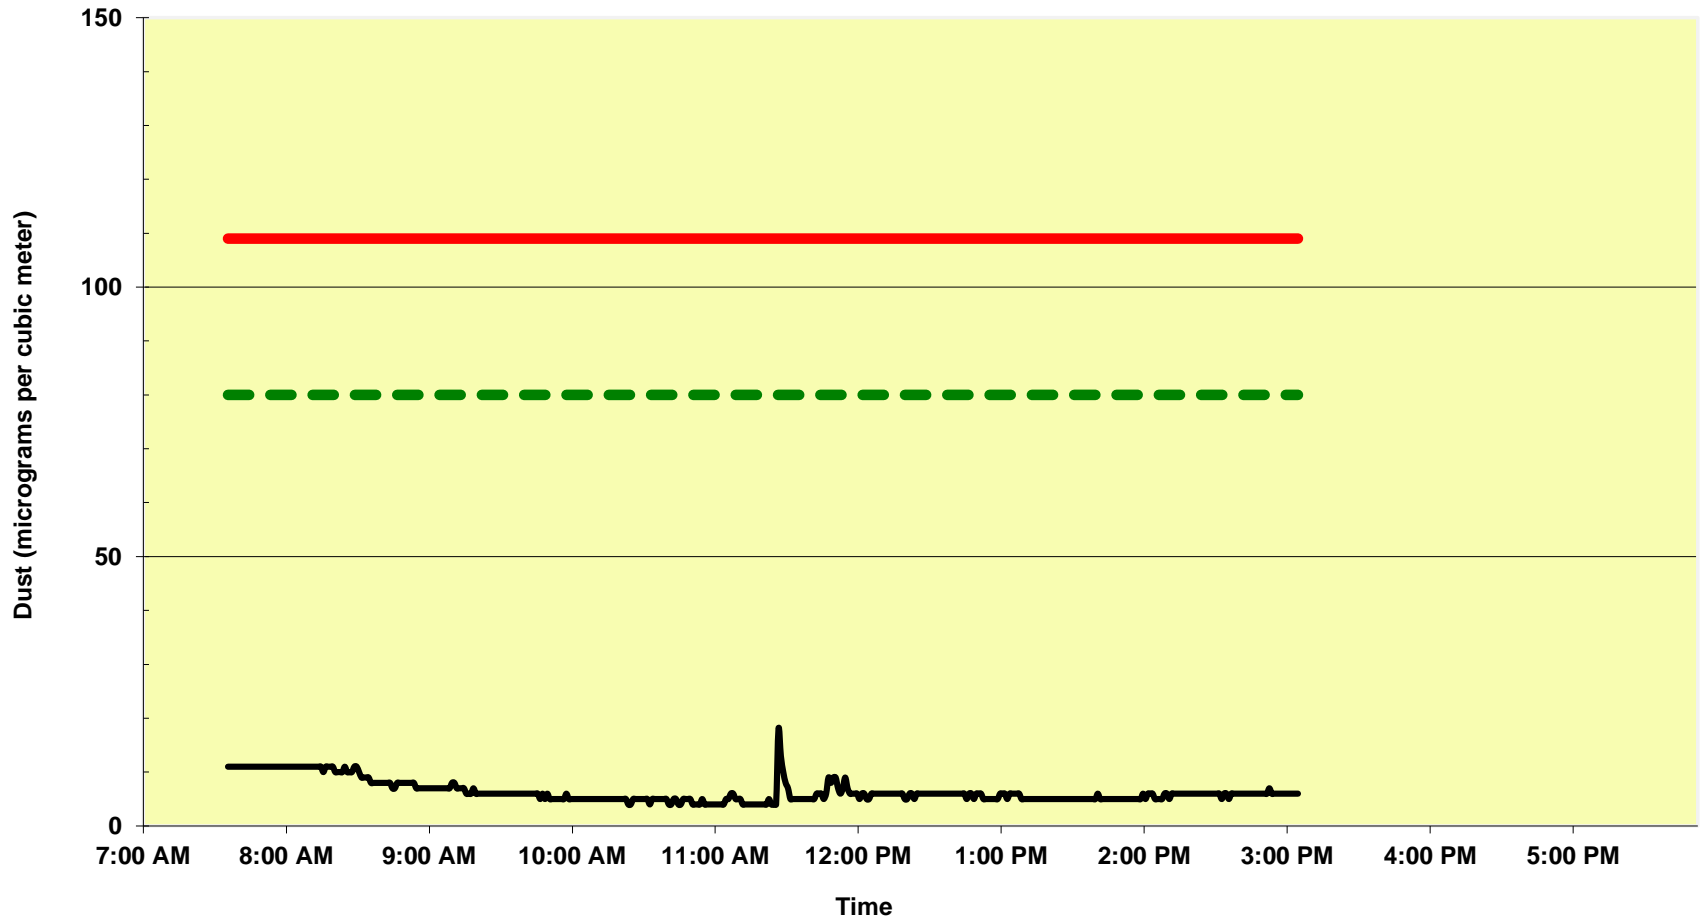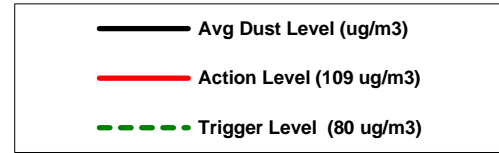



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 5 8/21/2018**

Air Monitoring Results

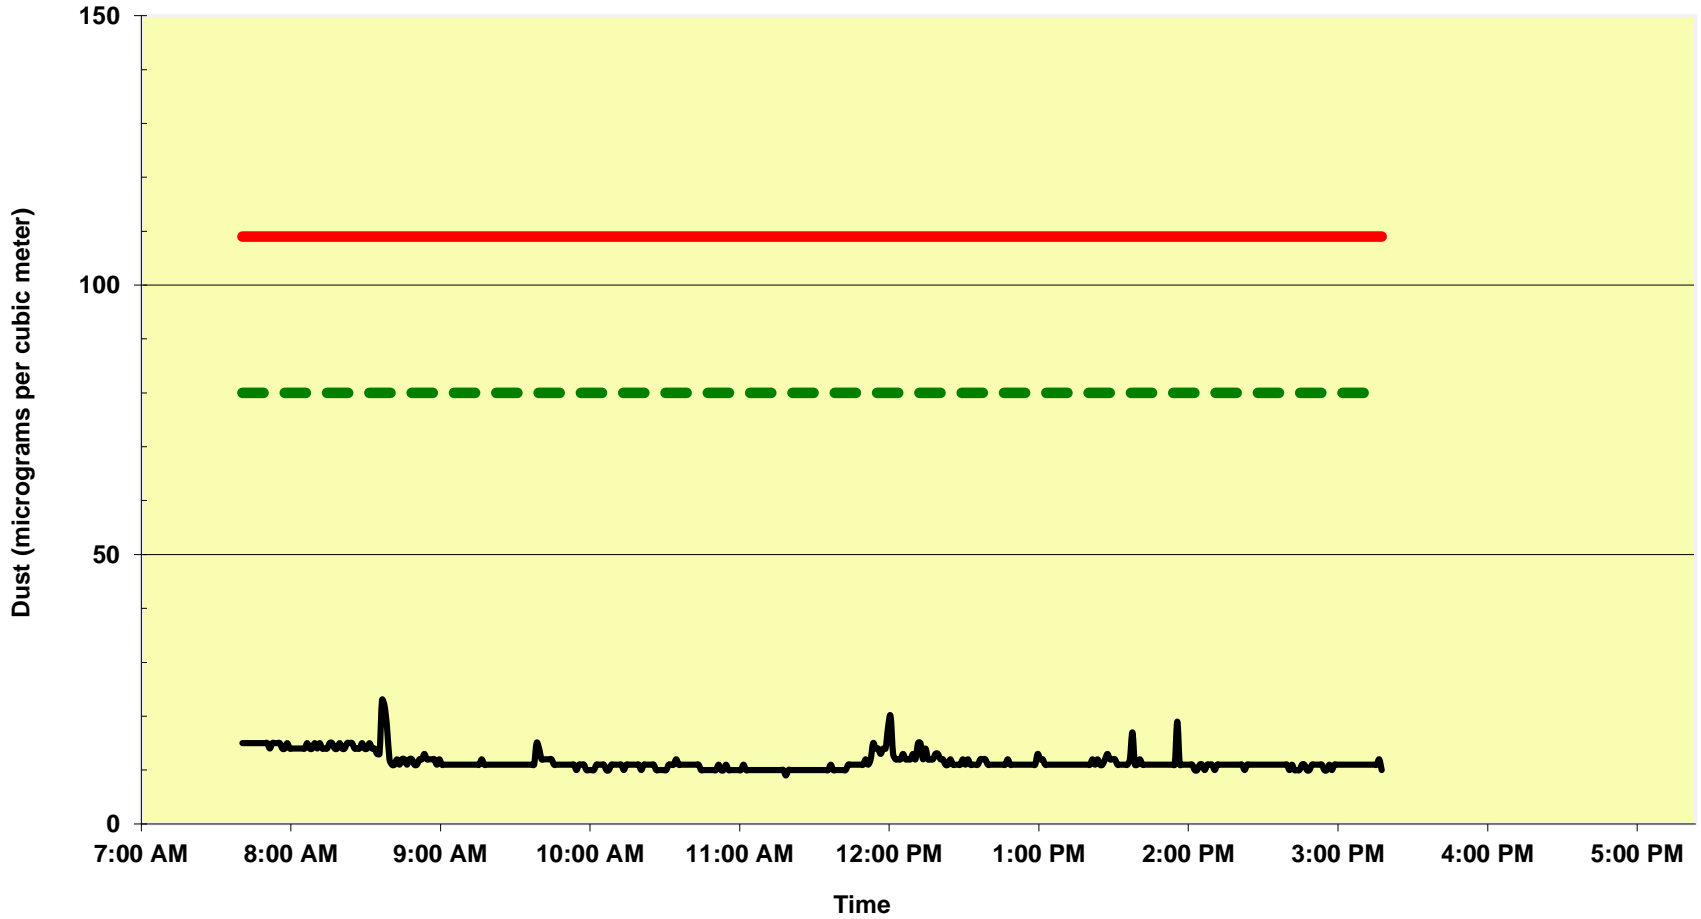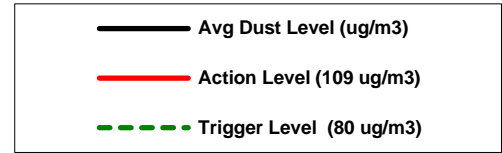



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 1 8/22/2018**

Air Monitoring Results

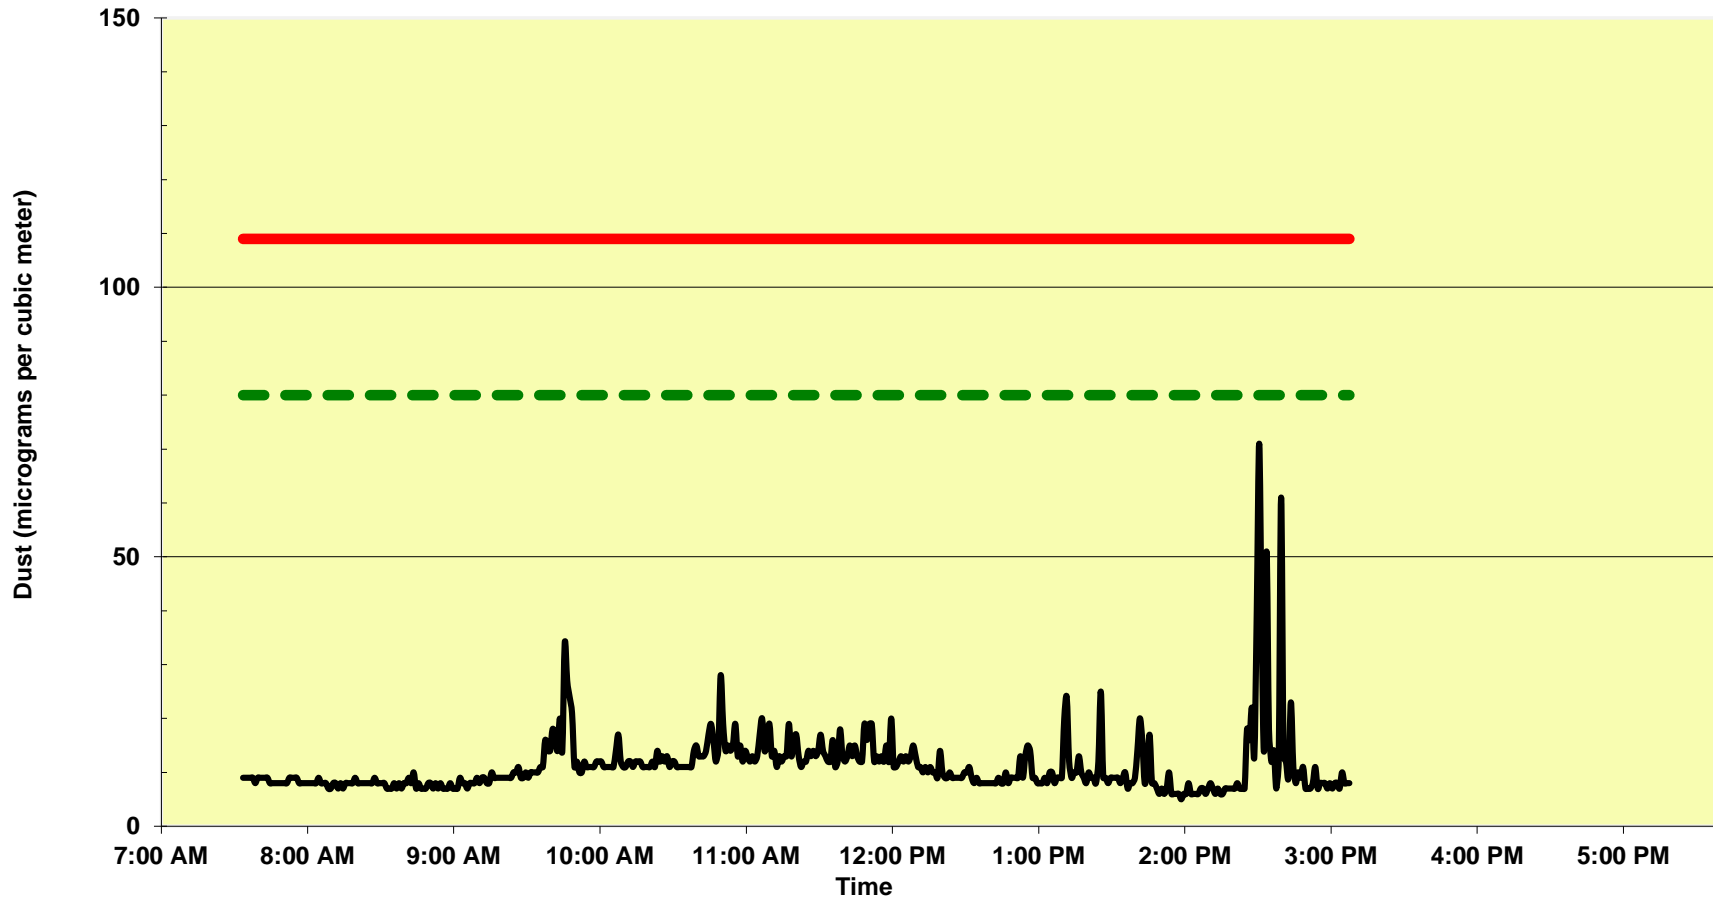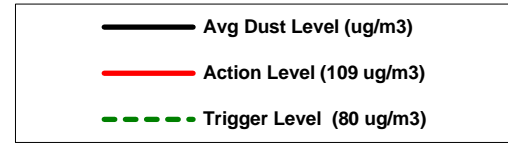



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 2 8/22/2018**

Air Monitoring Results

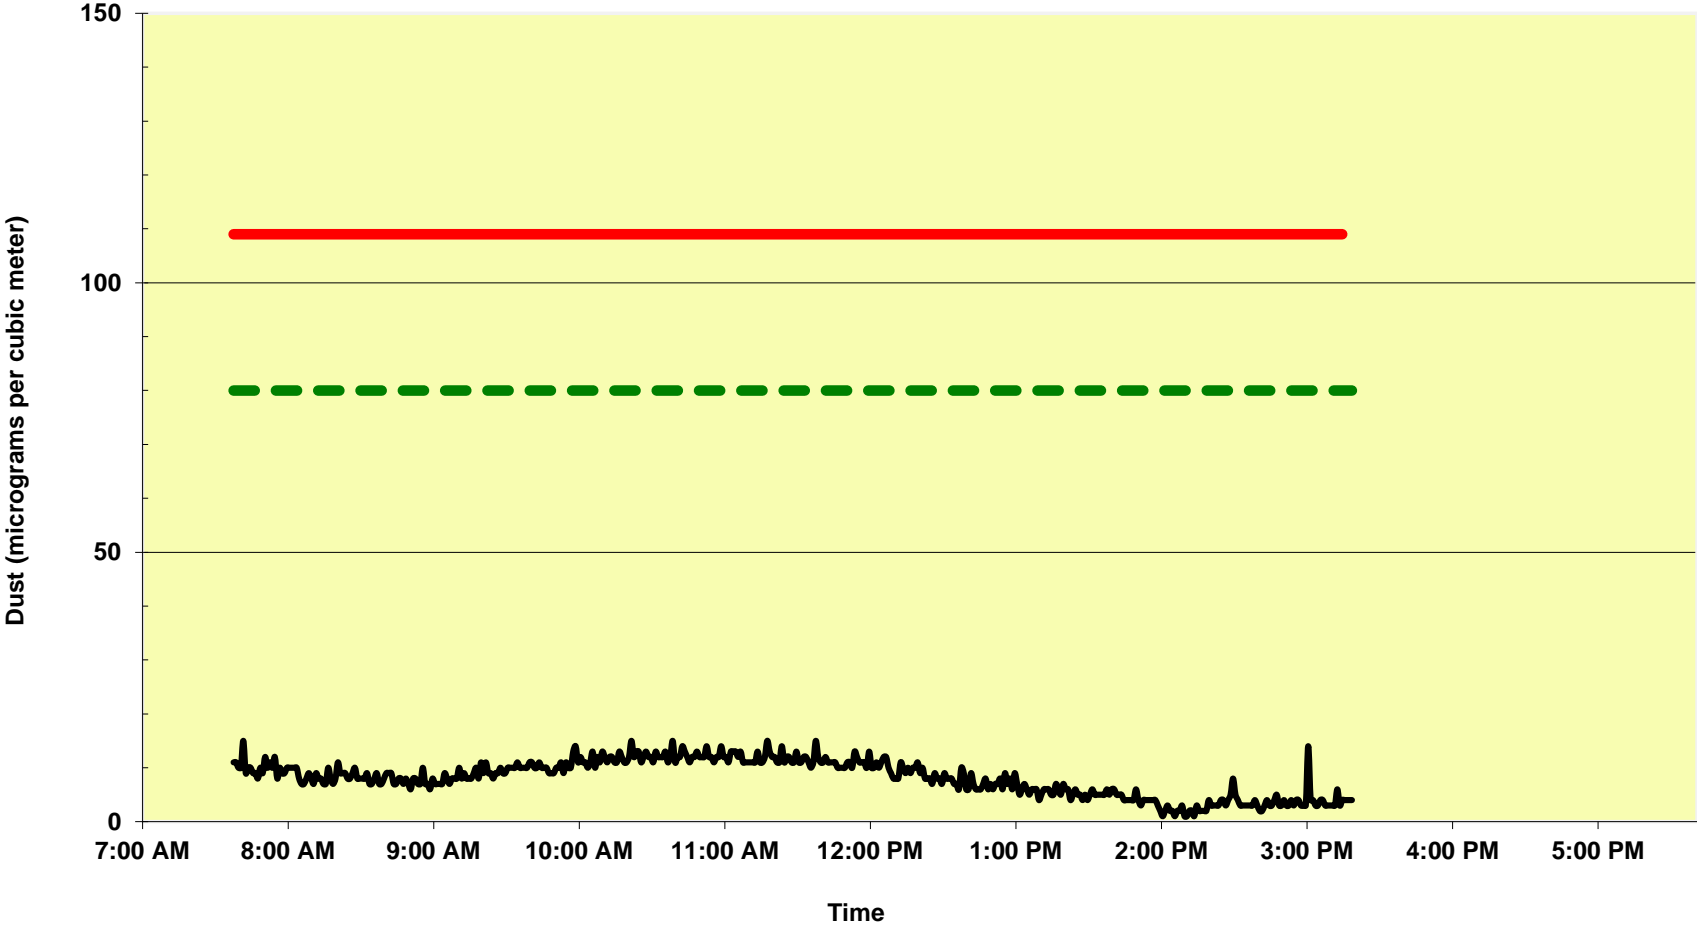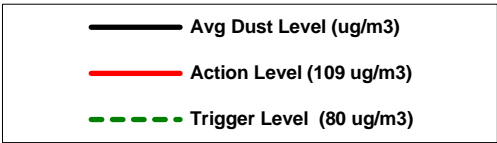



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 3 8/22/2018**

Air Monitoring Results

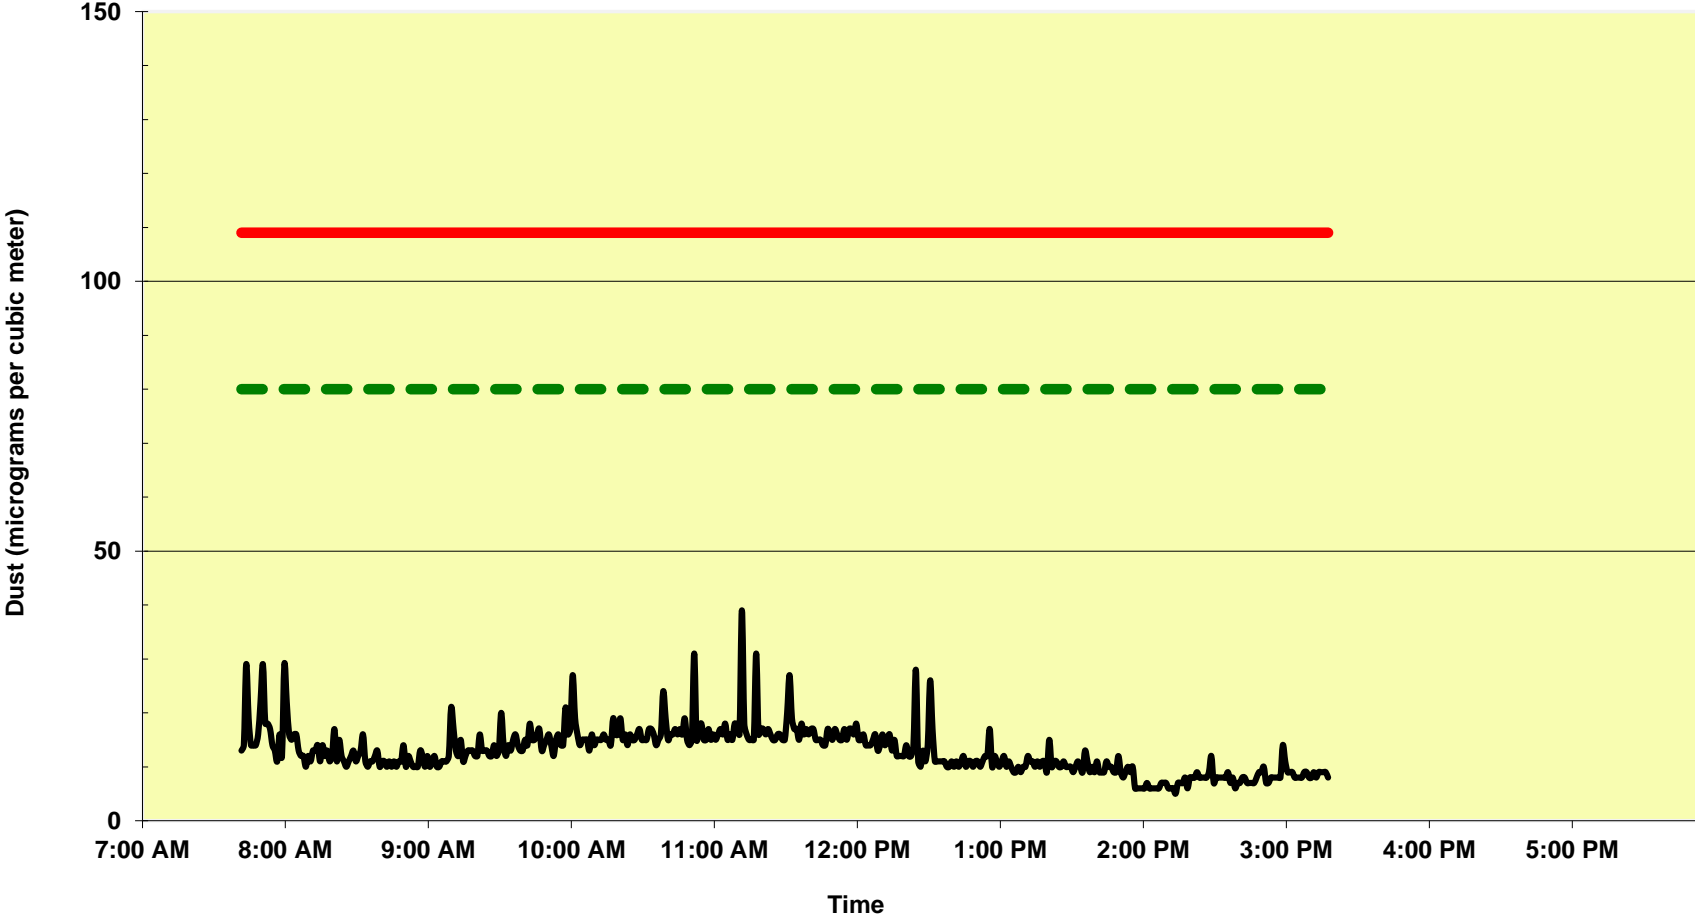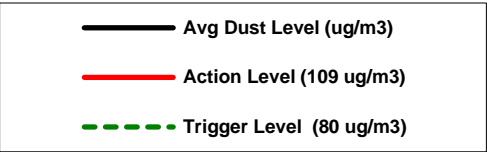



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 4 8/22/2018**

Air Monitoring Results

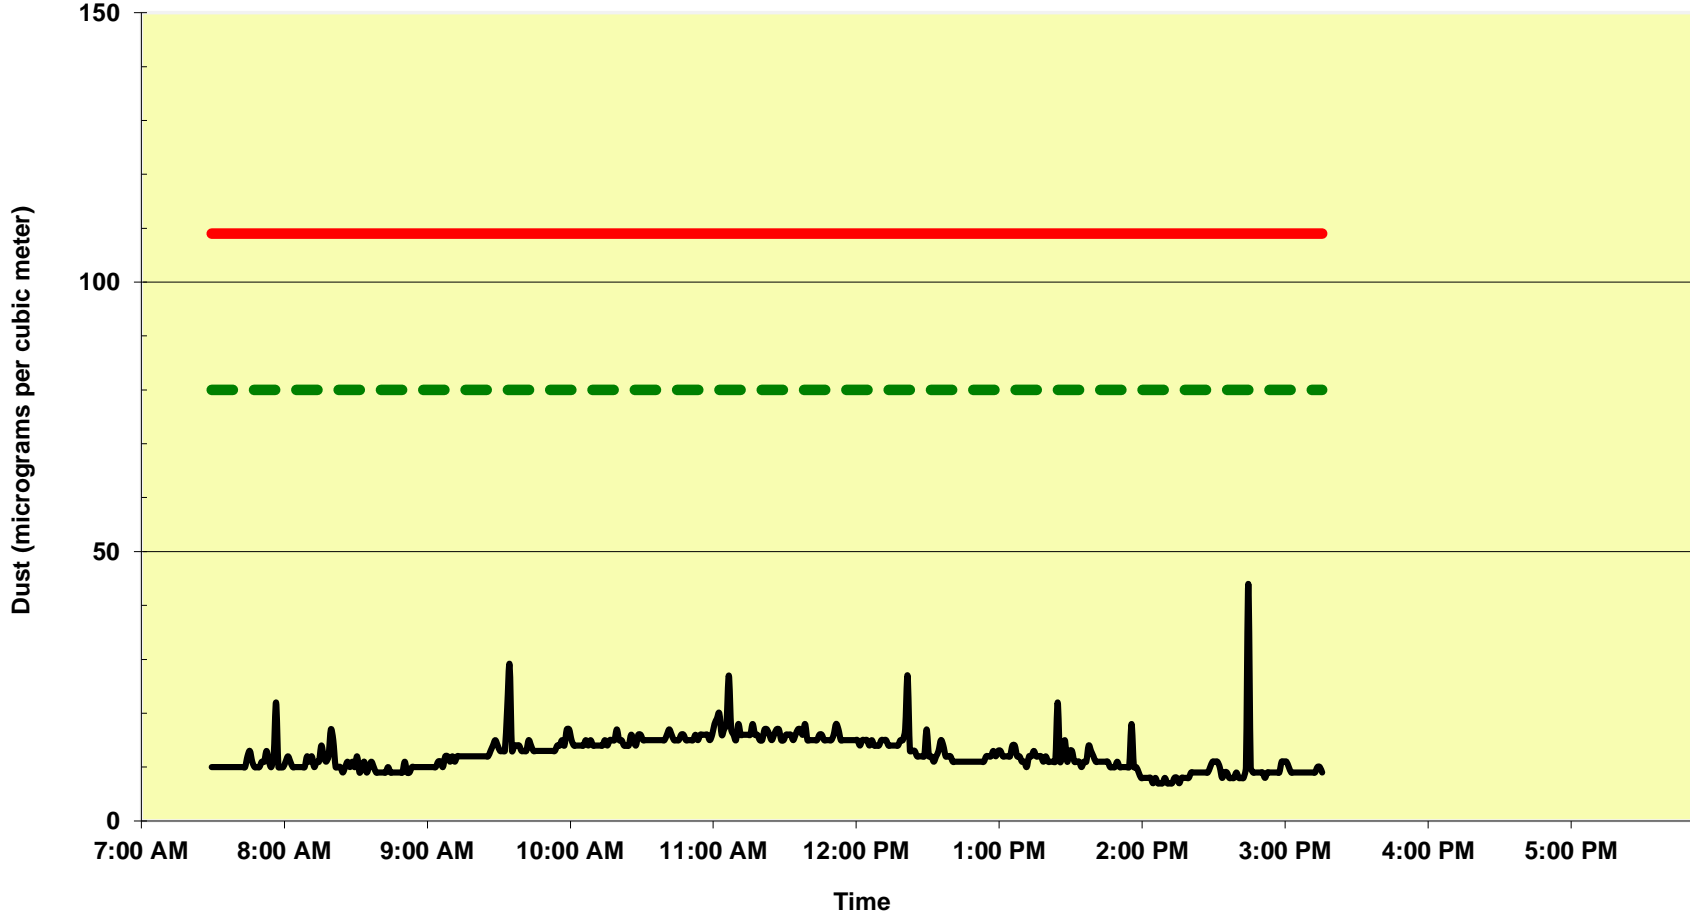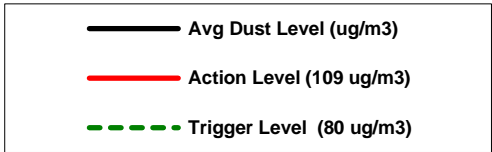



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 5 8/22/2018**

Air Monitoring Results

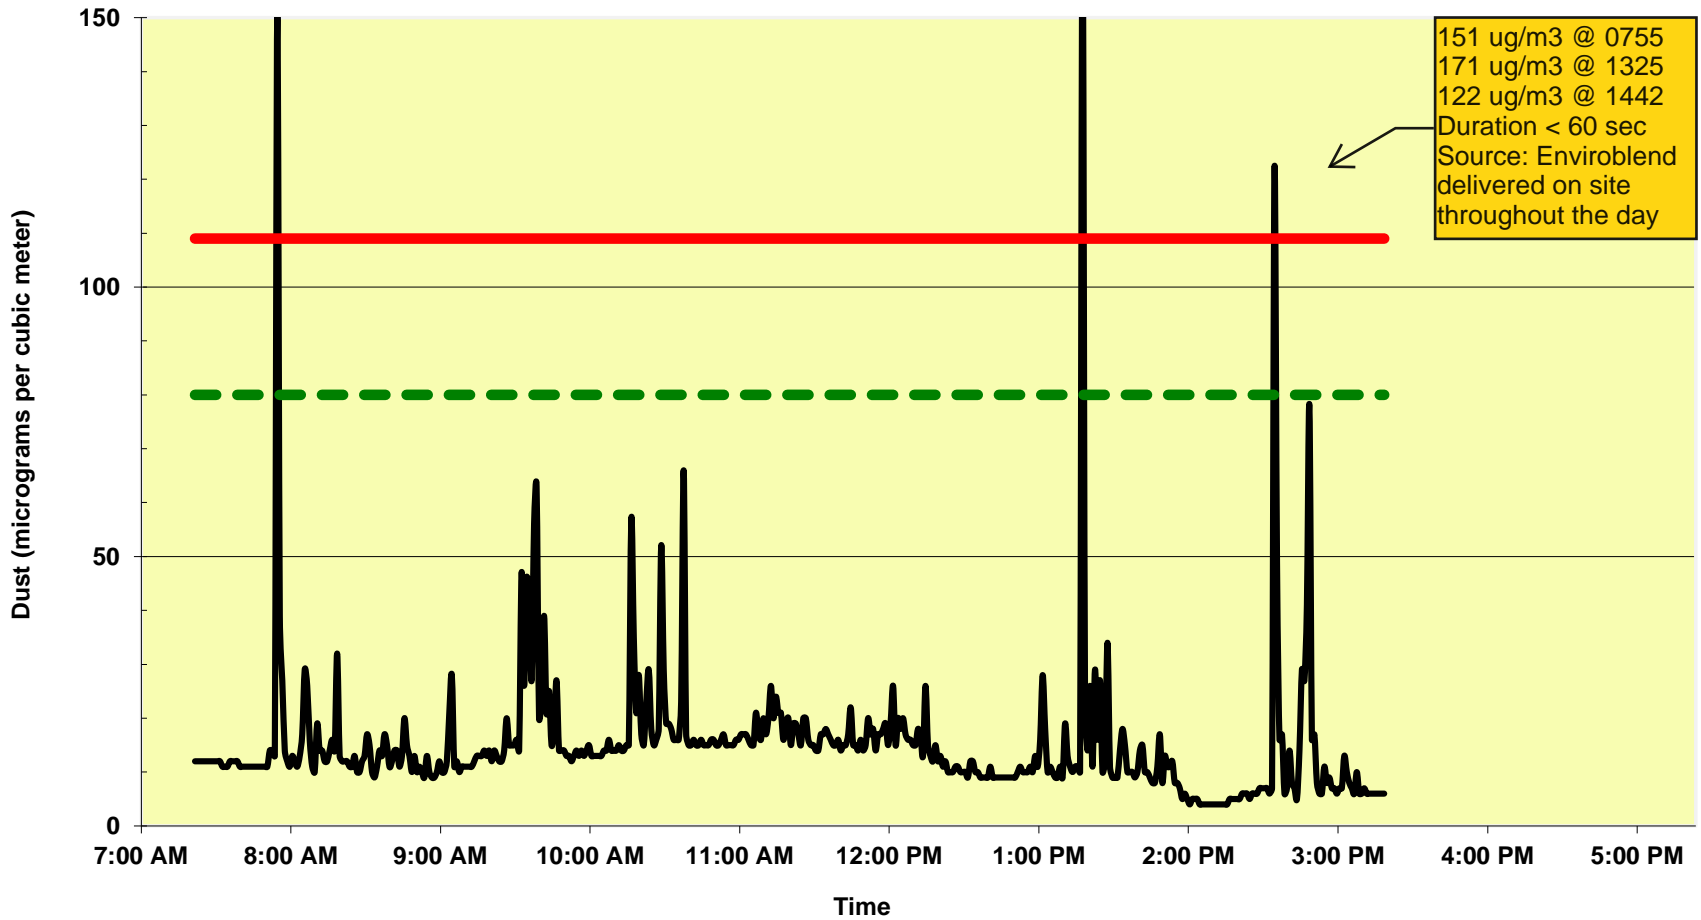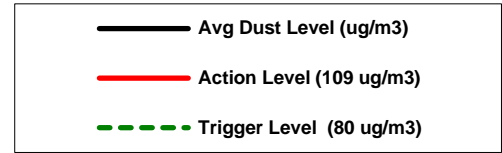



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 1 8/23/2018**

Air Monitoring Results

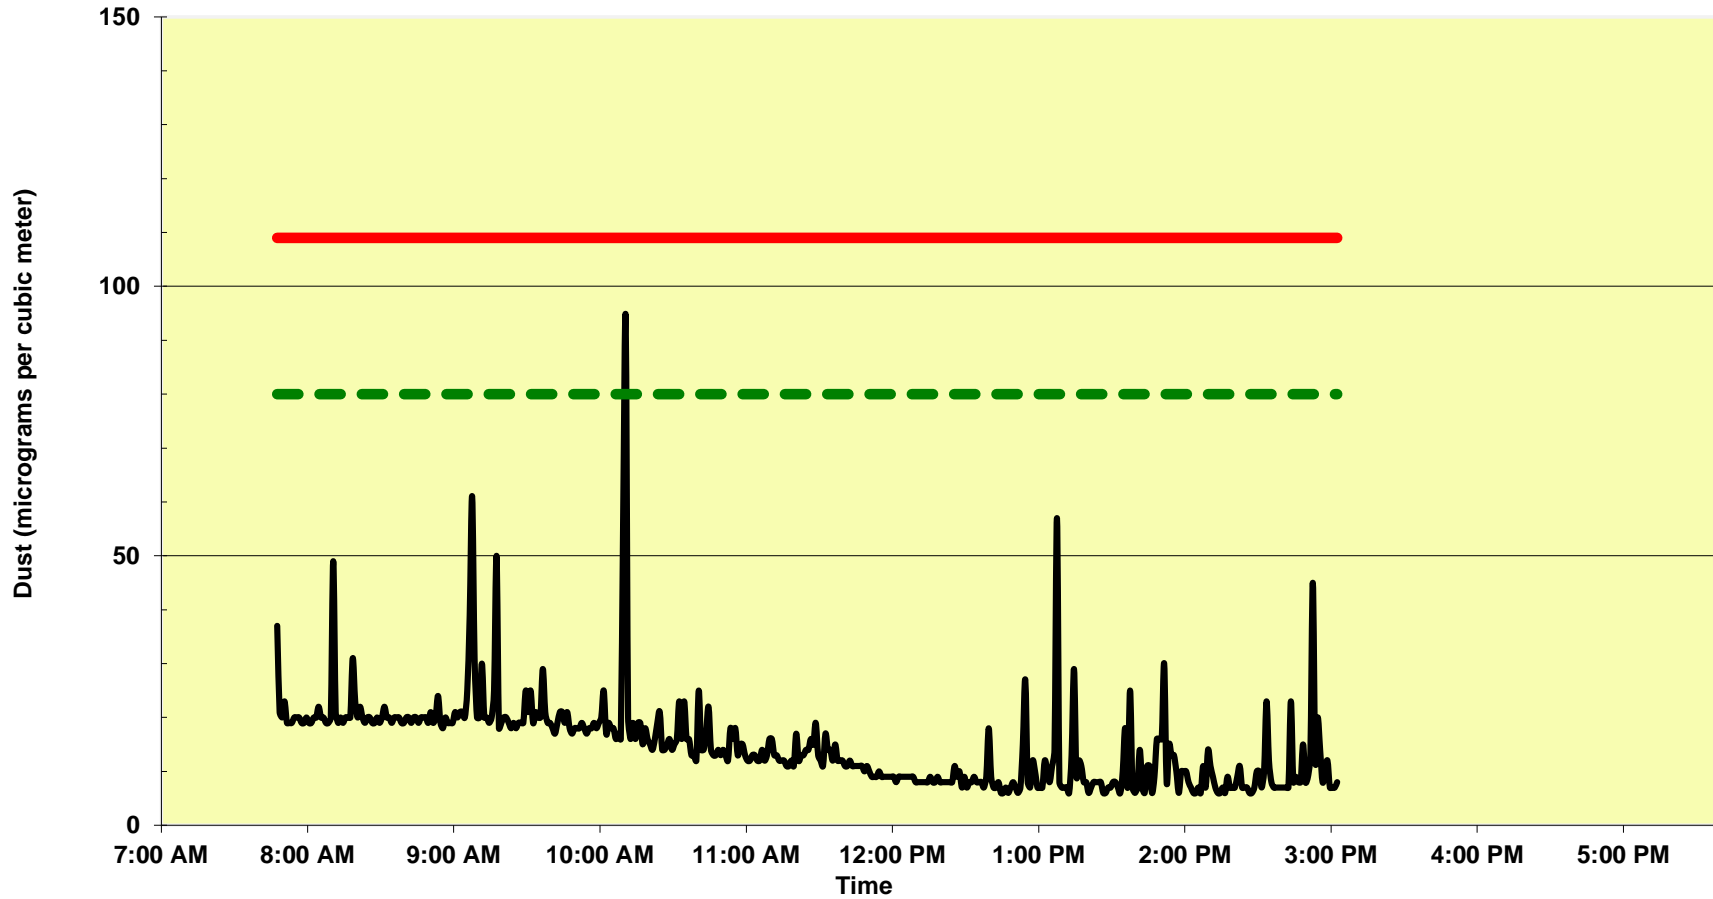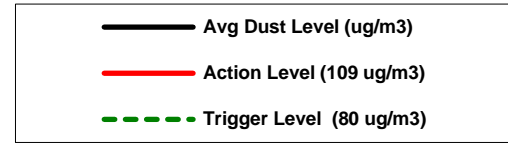



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 2 8/23/2018**

Air Monitoring Results

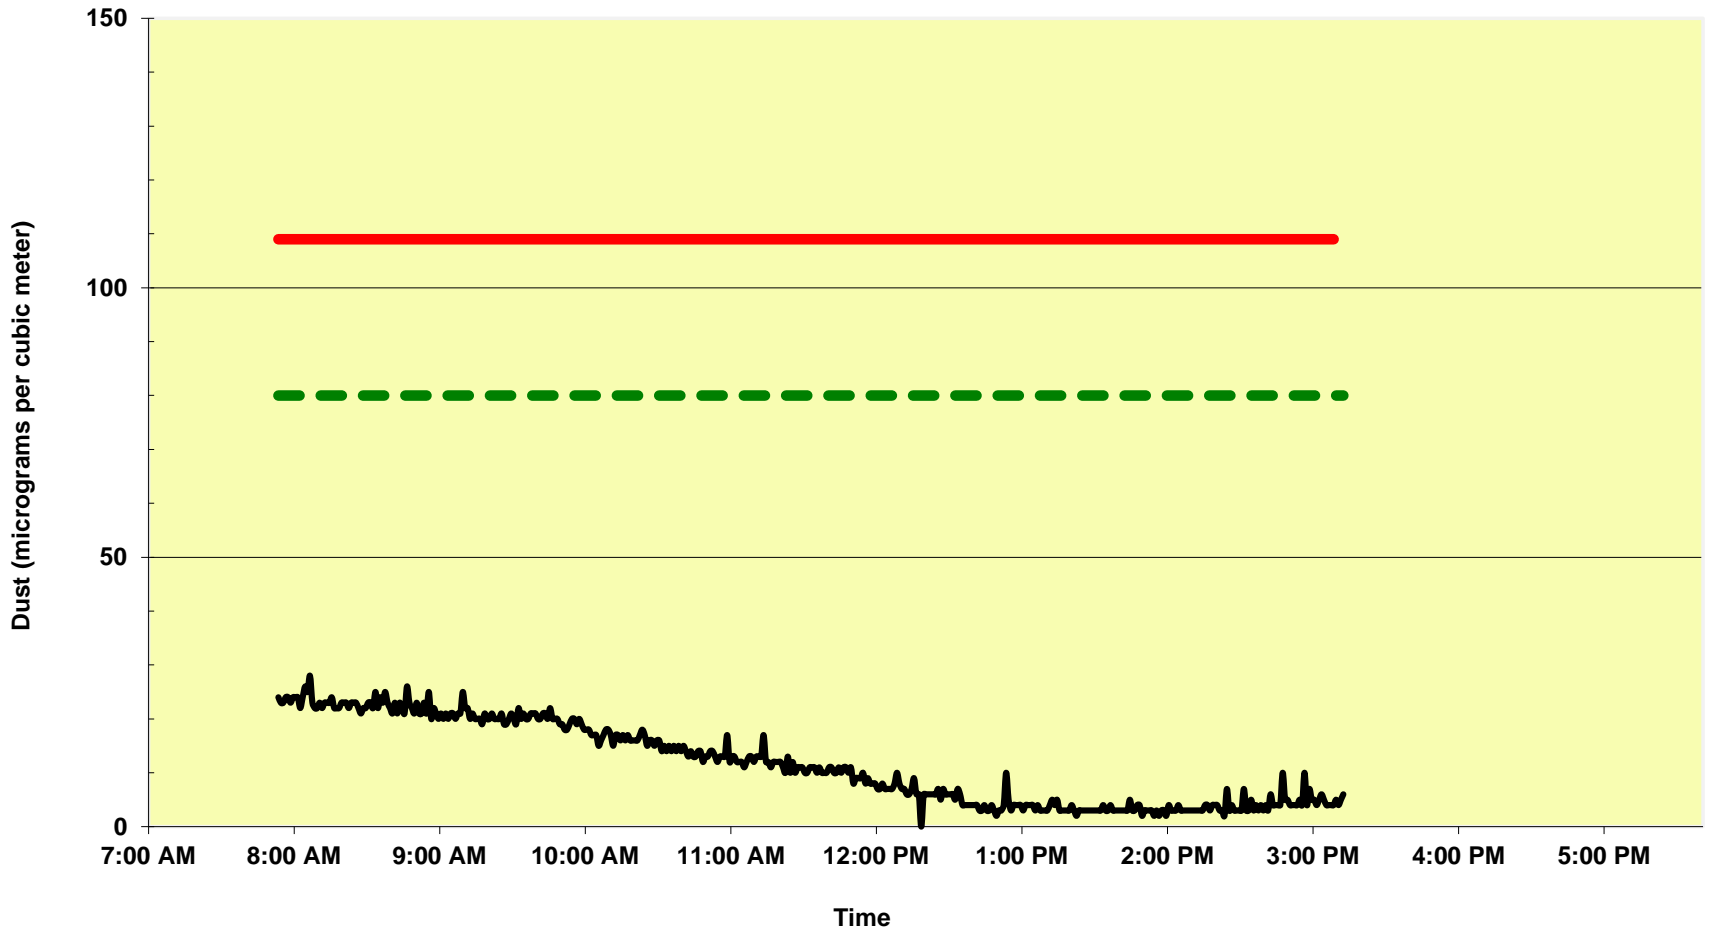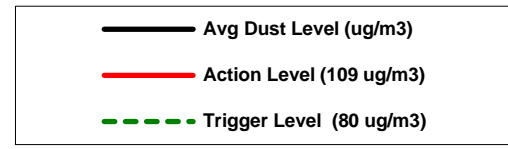



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 3 8/23/2018**

Air Monitoring Results

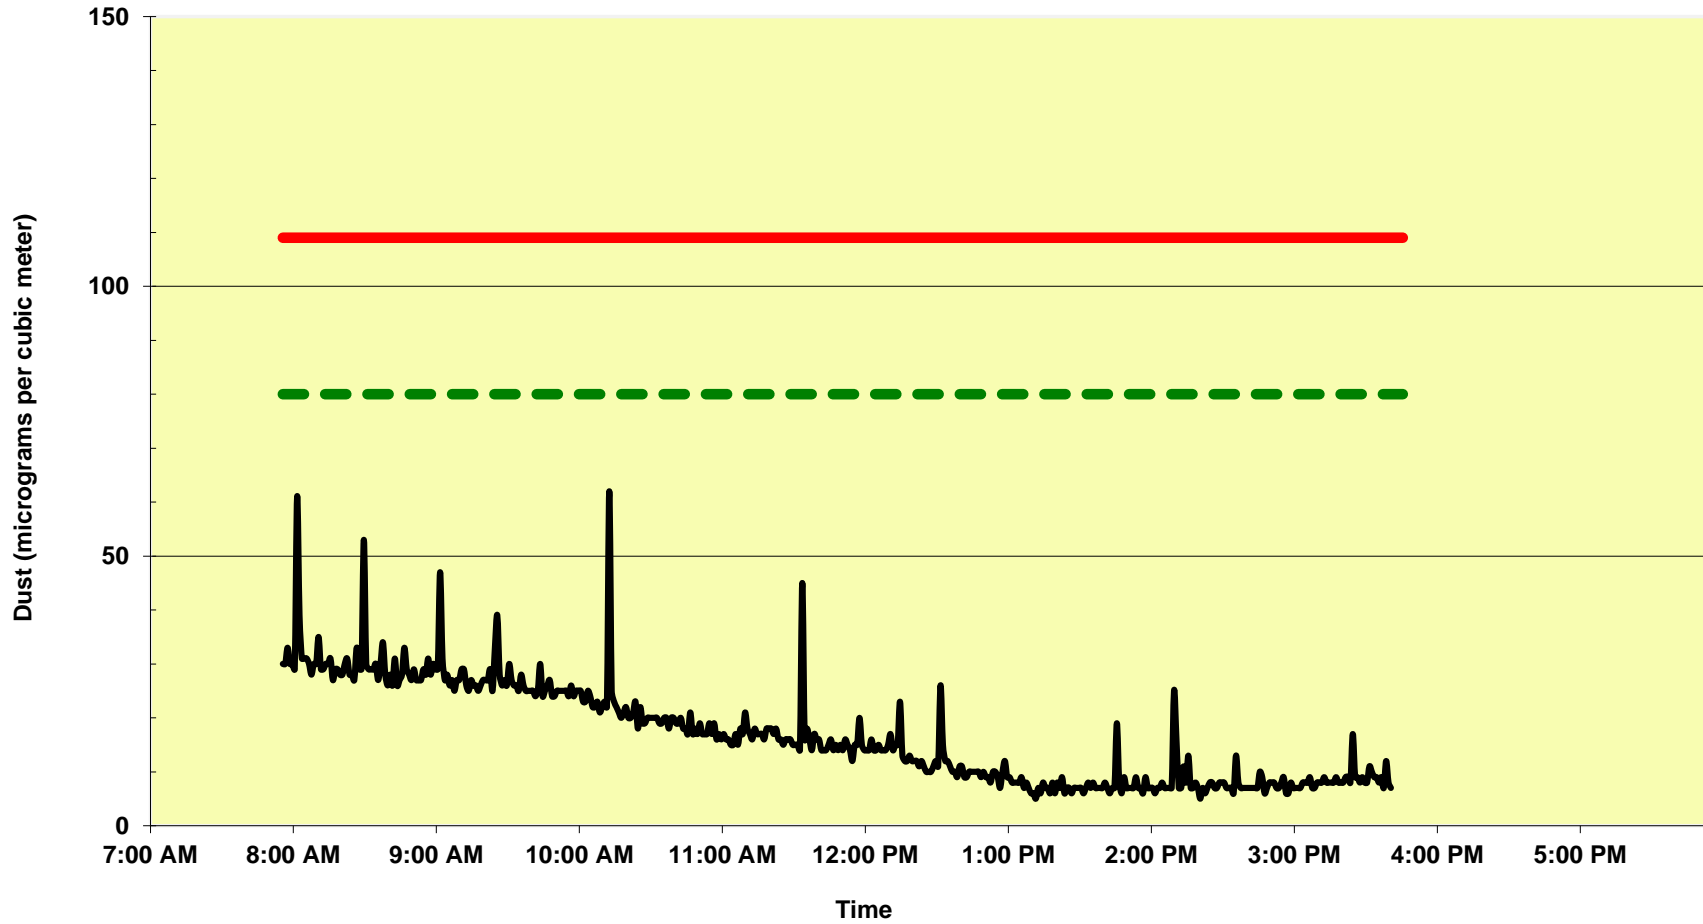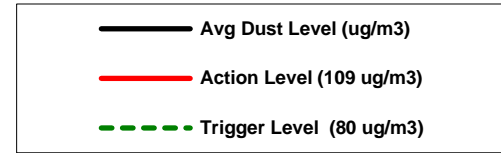



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 4 8/23/2018**

Air Monitoring Results

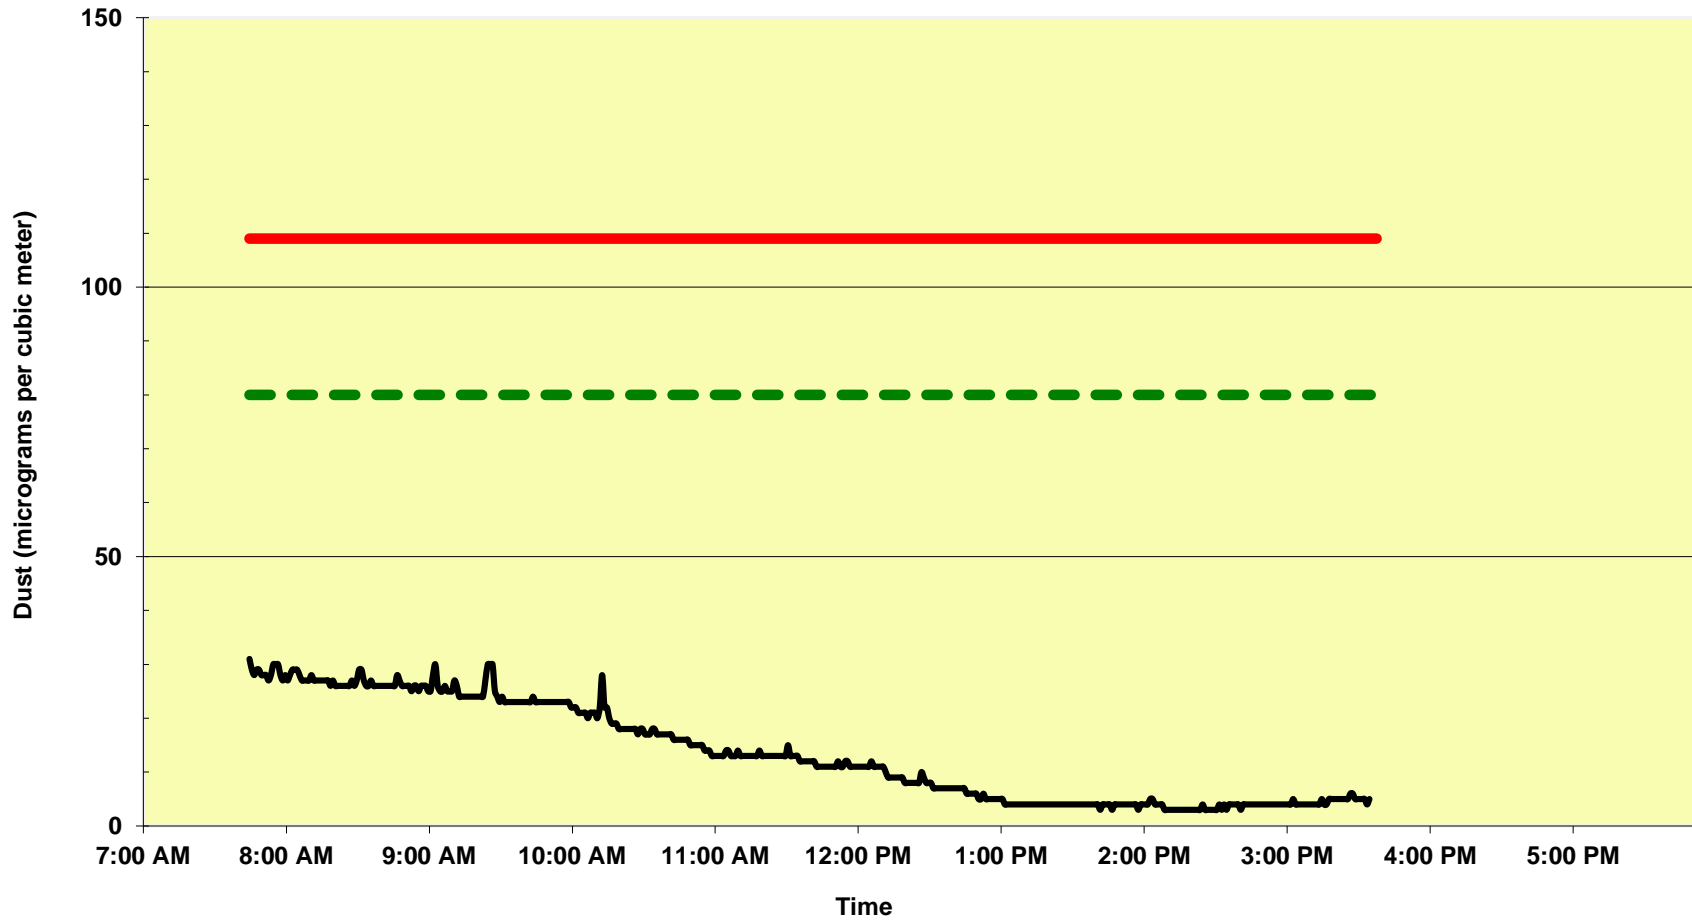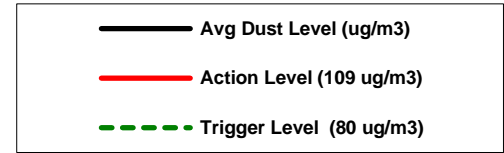



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 5 8/23/2018**

Air Monitoring Results

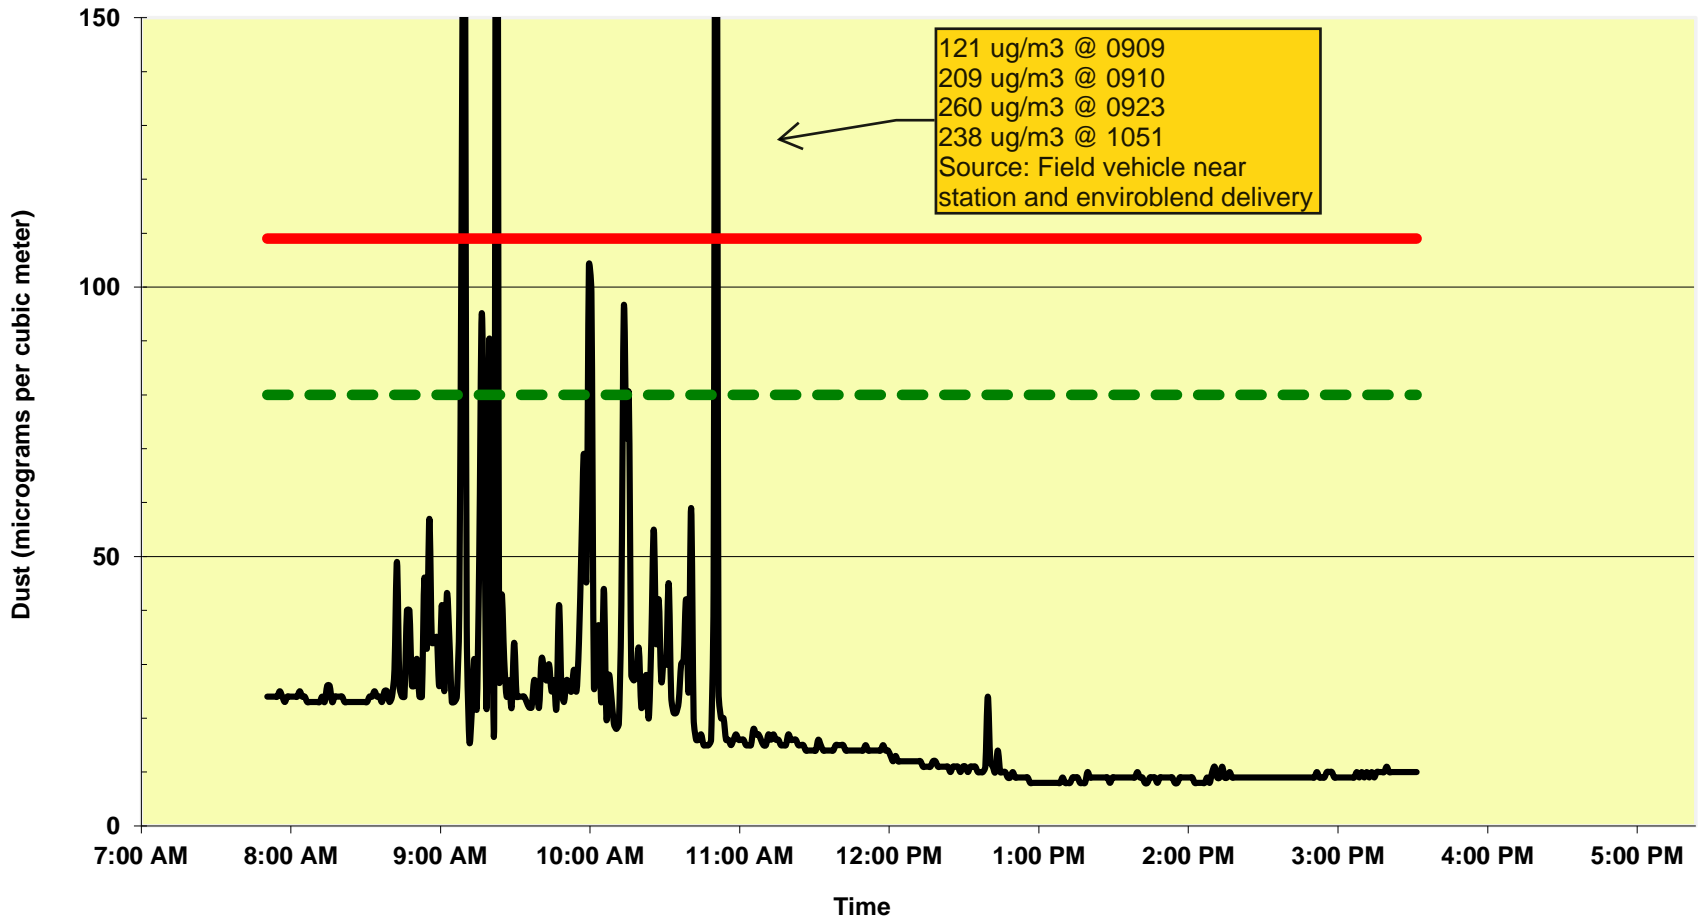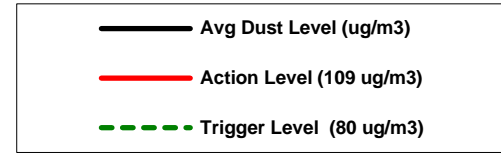



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 1 8/24/2018**

Air Monitoring Results

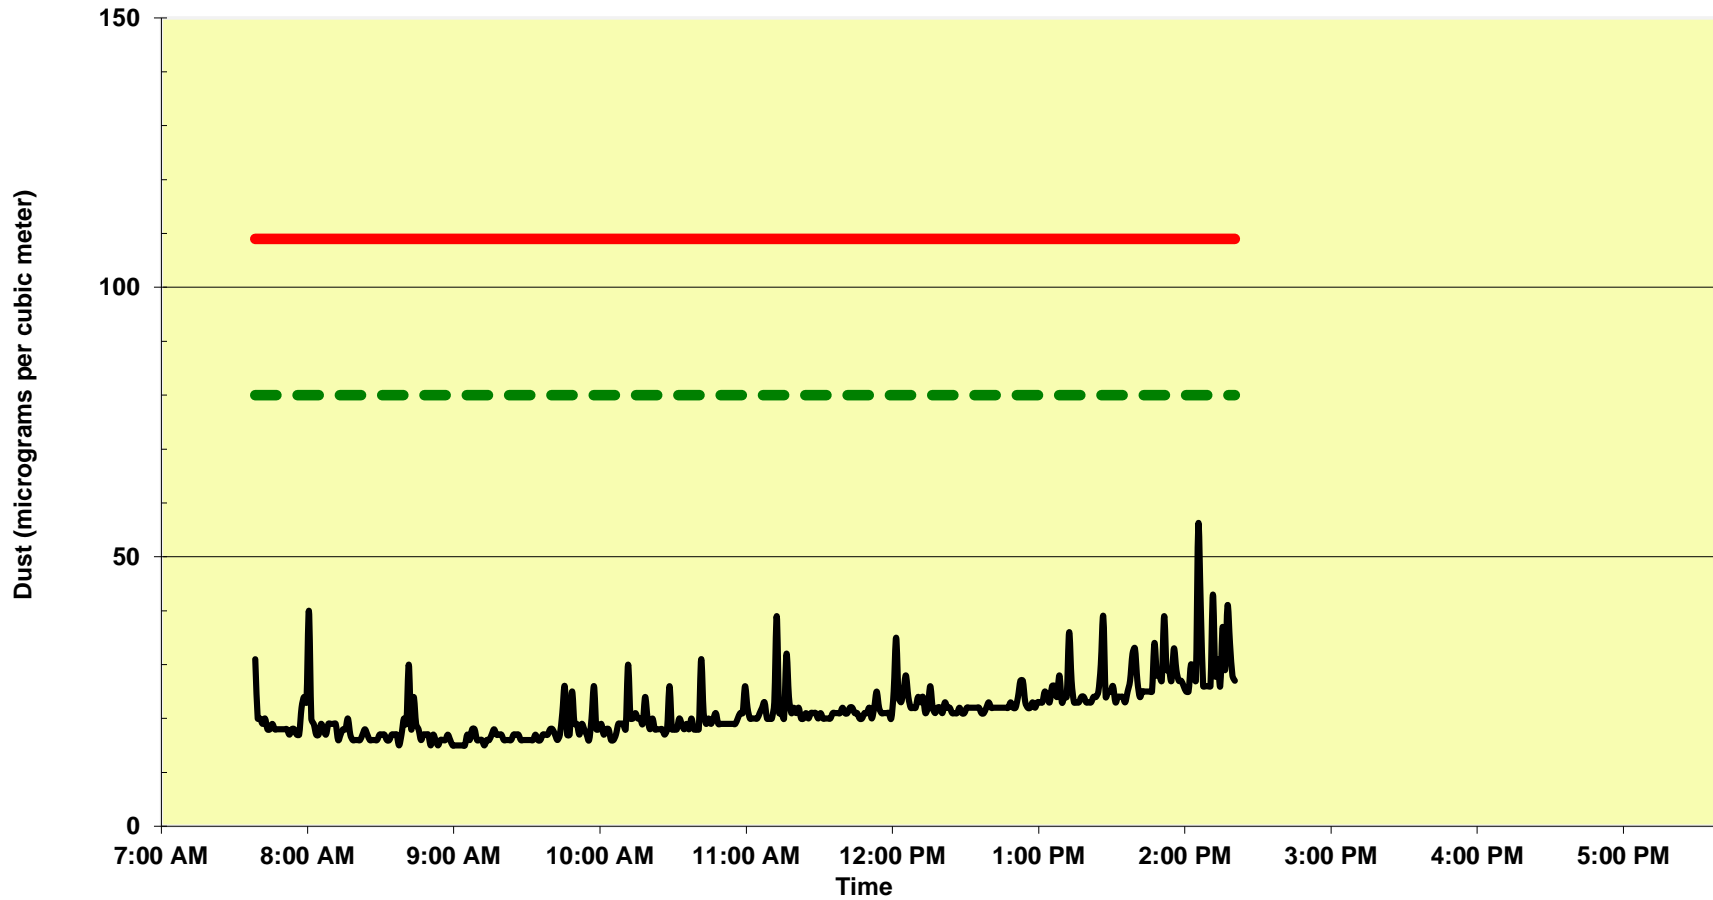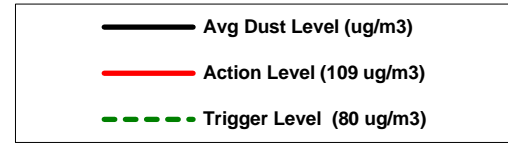



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 2 8/24/2018**

Air Monitoring Results

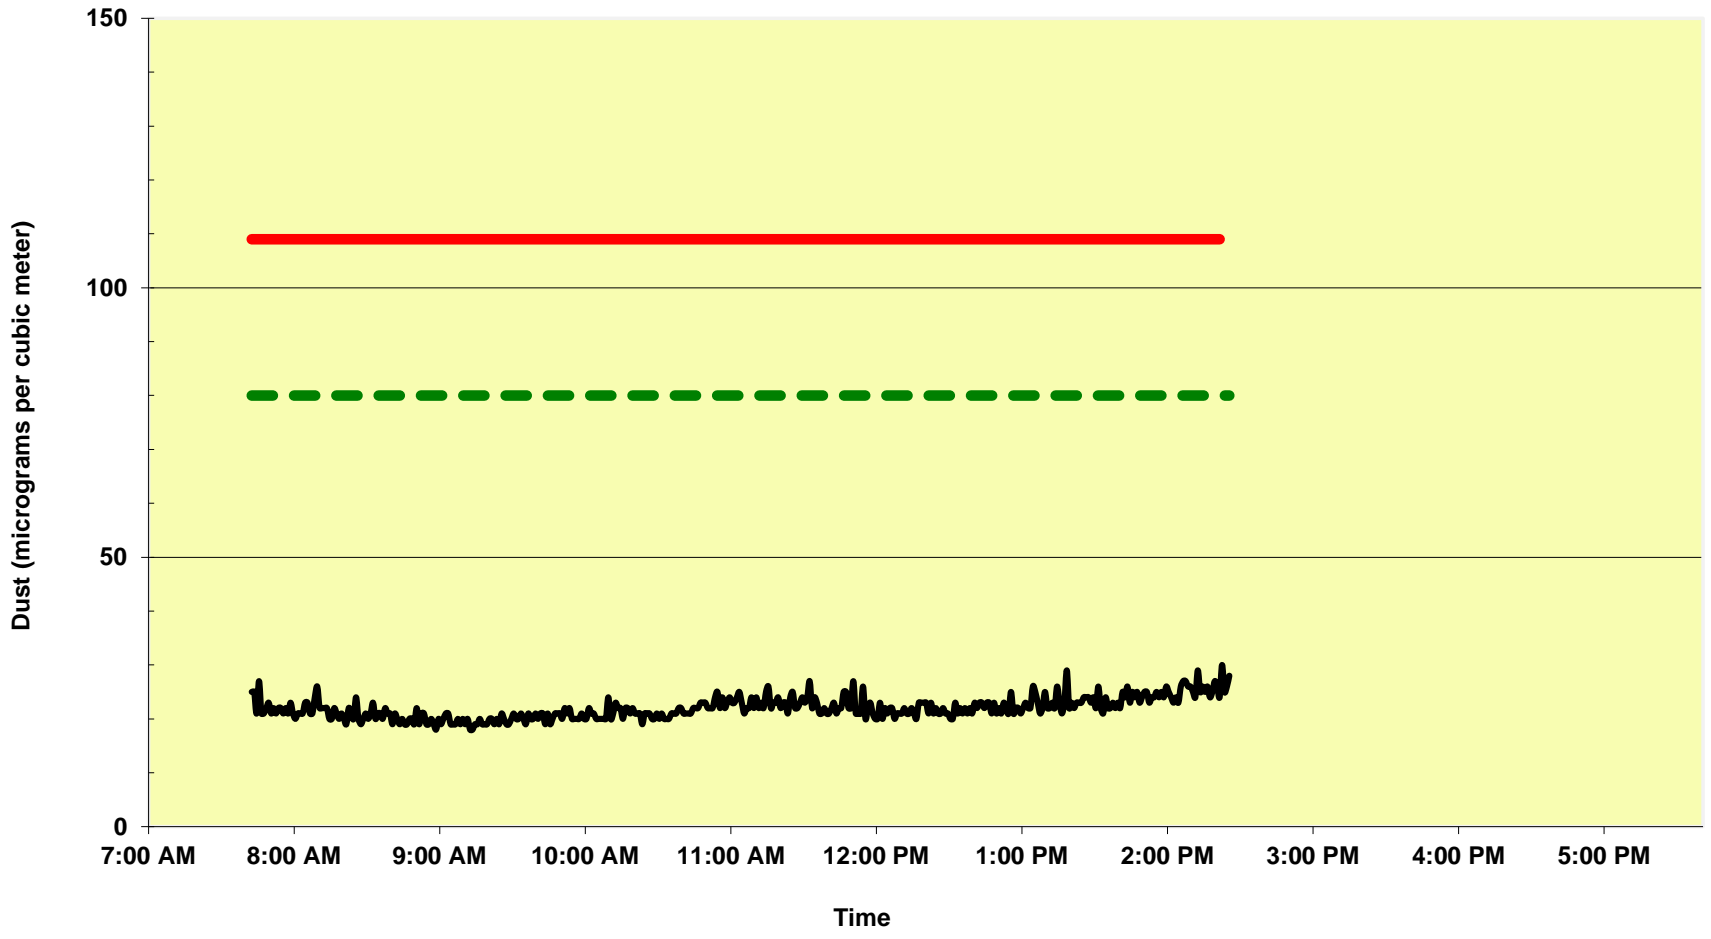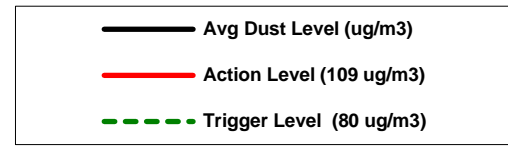



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 3 8/24/2018**

Air Monitoring Results

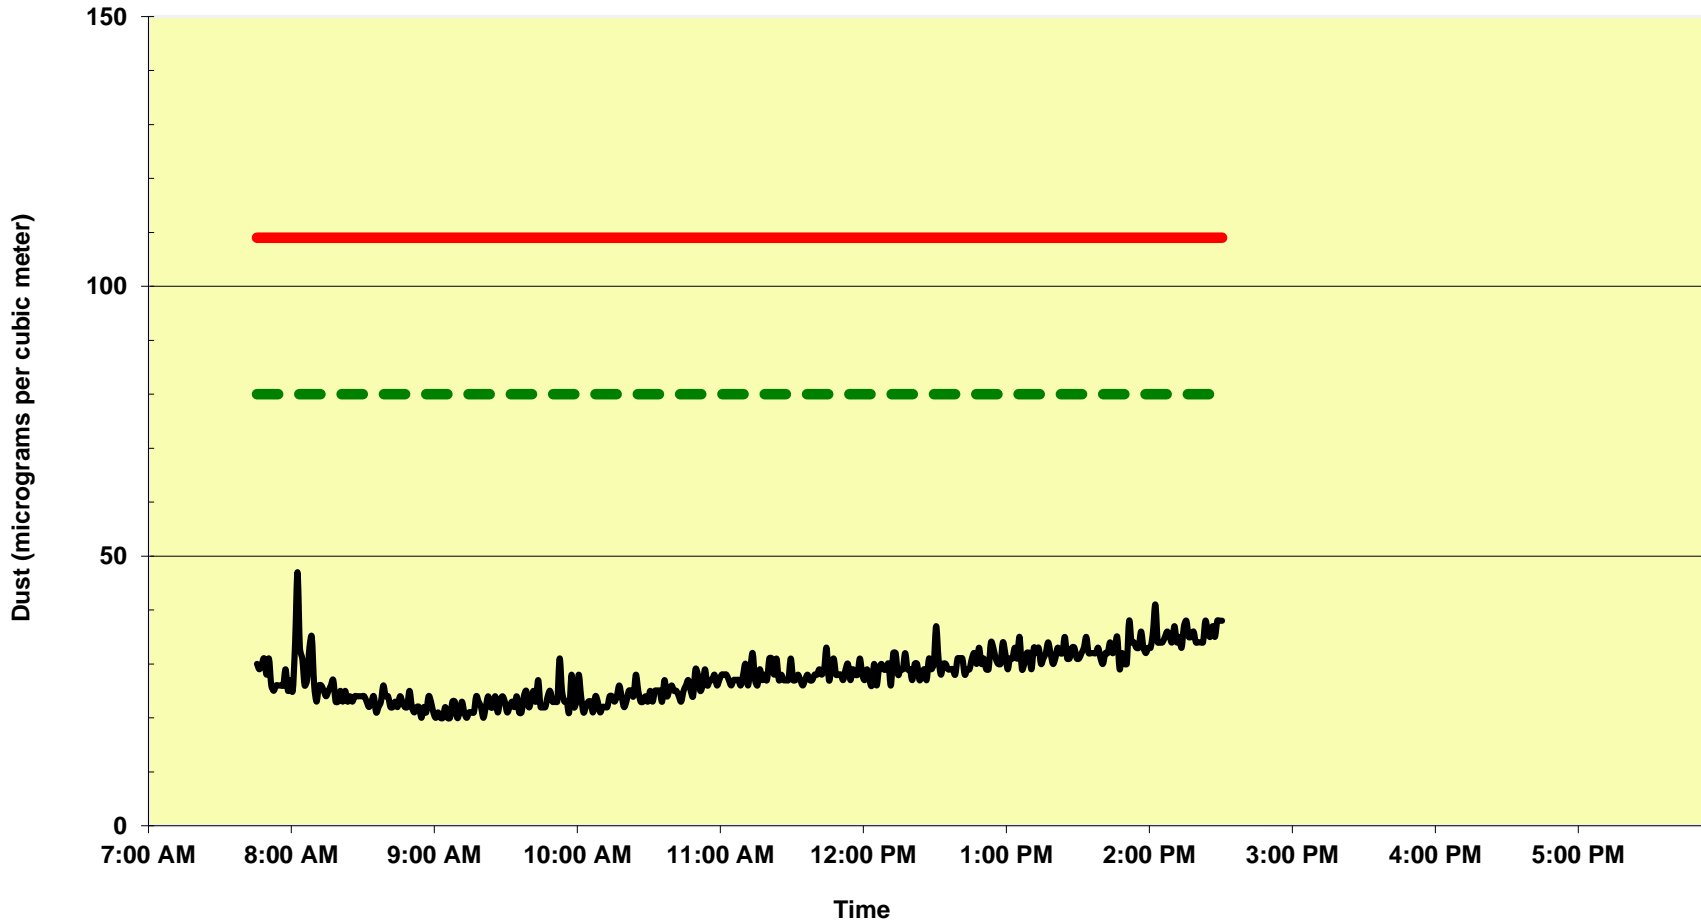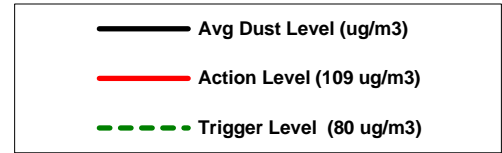



**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 4 8/24/2018**

Air Monitoring Results

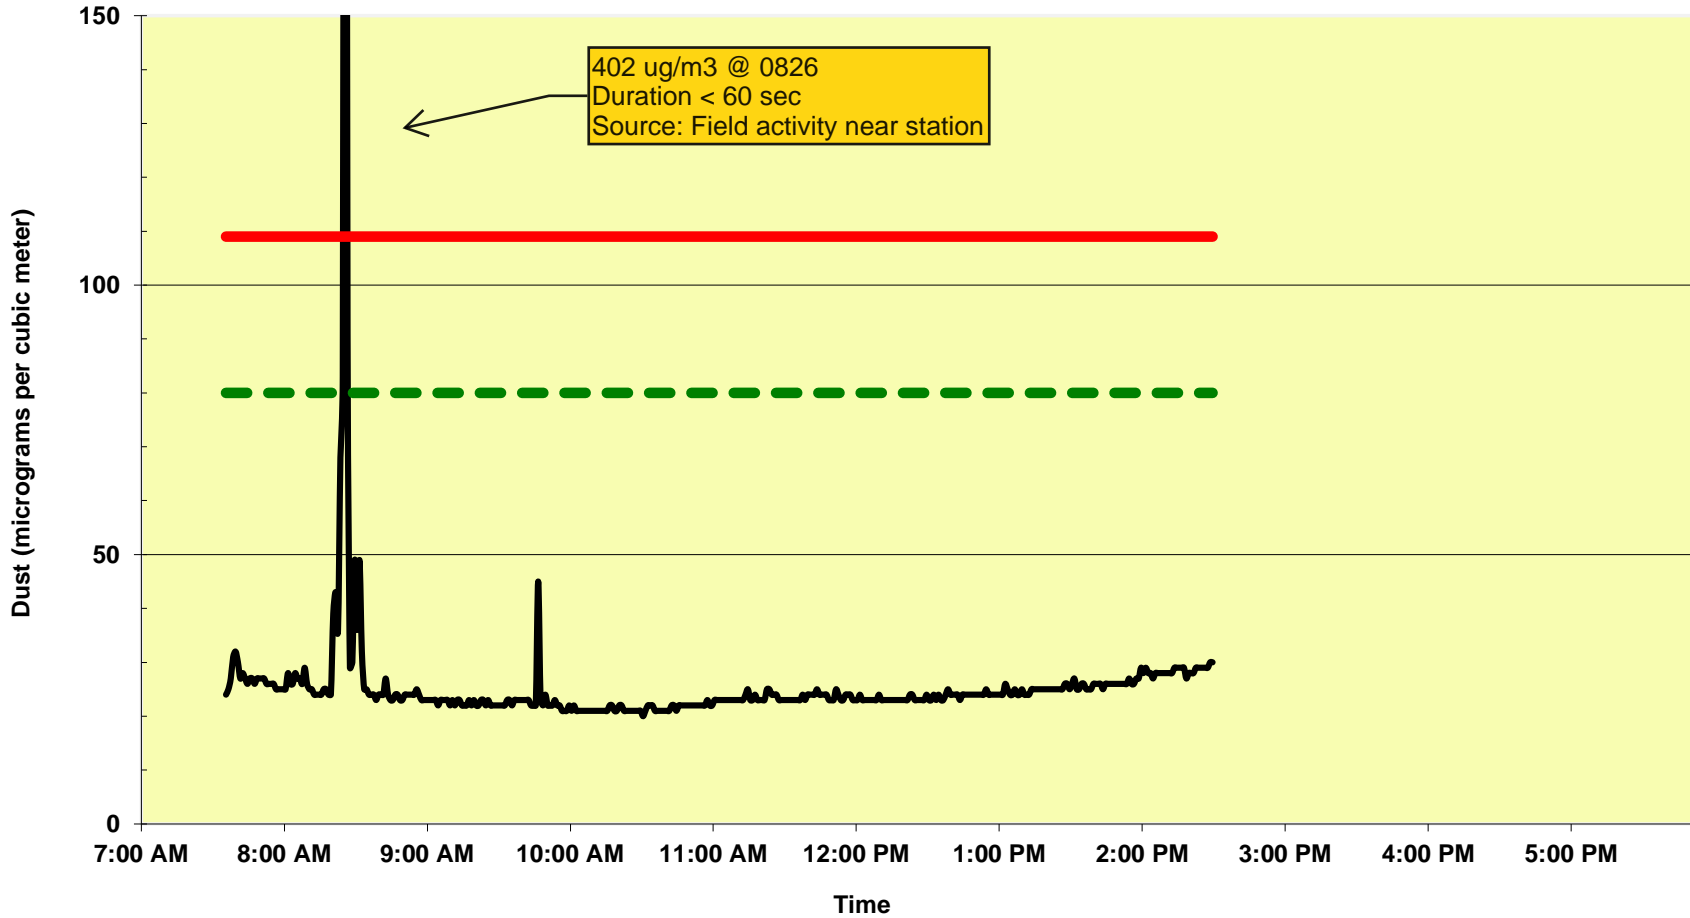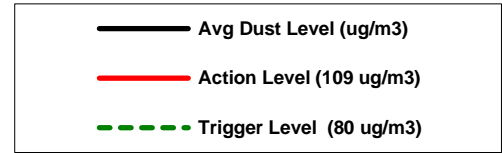

**Former Midland-Ross Site
Highland Park, New Jersey
Dust Monitoring Results
Air Monitor 5 8/24/2018**

Air Monitoring Results

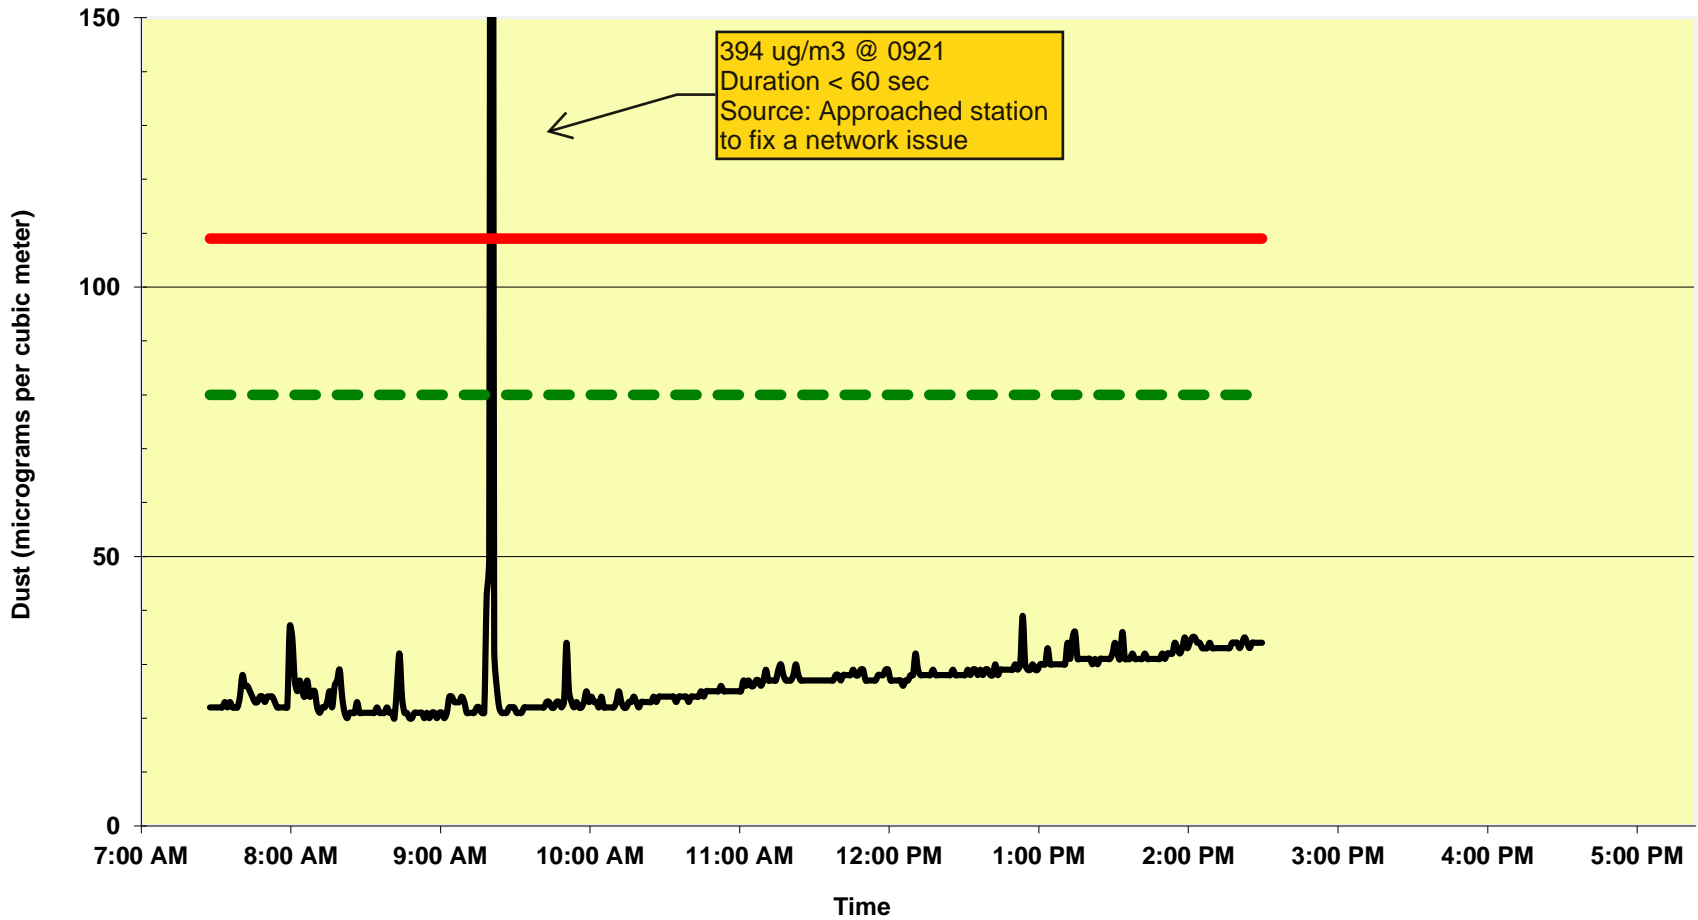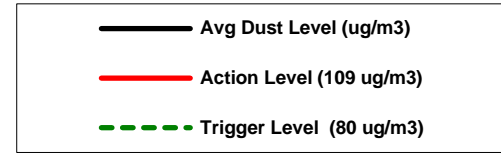

LABORATORY AIR SAMPLE RESULTS

PAMP METALS, PAHs, VOCs SAMPLES ANALYTICAL RESULTS
 HONEYWELL HIGHLAND PARK
 HIGHLAND PARK, NEW JERSEY

Analyte	CAS Number	Criteria	200-44963 AMS- 5-082218 4:00PM	Units	Qualifier
Metals					
Copper	7440-50-8	0.49	0.00033	mg/m3 Filter	U ^
Lead	7439-92-1	0.00049	0.000067	mg/m3 Filter	U ^
PAHs					
Anthracene	120-12-7	31	0.028	ug/m3 PUF	U
Phenanthrene	85-01-8	310	0.061	ug/m3 PUF	
Pyrene	129-00-0	310	0.028	ug/m3 PUF	U
Fluoranthene	206-44-0	310	0.028	ug/m3 PUF	U
Acenaphthylene	208-96-8	310	0.028	ug/m3 PUF	U *
Naphthalene	91-20-3	14.6	0.082	ug/m3 PUF	*
Fluorene	86-73-7	310	0.028	ug/m3 PUF	U
Acenaphthene	83-32-9	310	0.028	ug/m3 PUF	U *
Benzo[a]anthracene	56-55-3	0.3	0.028	ug/m3 PUF	U
Indeno[1,2,3-cd]pyrene	193-39-5	3.1	0.028	ug/m3 PUF	U
Dibenz(a,h)anthracene	53-70-3	0.3	0.028	ug/m3 PUF	U
Benzo[g,h,i]perylene	191-24-2	31	0.028	ug/m3 PUF	U
Benzo[a]pyrene	50-32-8	3.1	0.028	ug/m3 PUF	U
Chrysene	218-01-9	31	0.028	ug/m3 PUF	U
Benzo[b]fluoranthene	205-99-2	3.1	0.028	ug/m3 PUF	U *
Benzo[k]fluoranthene	207-08-9	3.1	0.028	ug/m3 PUF	U
VOCs					
Chlorobenzene	108-90-7	4867	0.9	ug/m3	U
Ethylene Dibromide	106-93-4	3.9	2	ug/m3	U
Ethylbenzene	100-41-4	4867	1	ug/m3	
o-Xylene	95-47-6	487	1	ug/m3	
Styrene	100-42-5	4867	0.9	ug/m3	U
m-Xylene & p-Xylene	179601-23-1	487	3	ug/m3	

PAMP METALS, PAHs, VOCs SAMPLES ANALYTICAL RESULTS
 HONEYWELL HIGHLAND PARK
 HIGHLAND PARK, NEW JERSEY

Analyte	CAS Number	Criteria	200-44963 AMS- 5-082218 4:00PM	Units	Qualifier
Chlorodibromomethane	124-48-1	12.6	2	ug/m3	U
4-Methyl-2-pentanone (MIBK)	108-10-1	14600	2	ug/m3	U
Toluene	108-88-3	24333	5	ug/m3	
Dichlorobromomethane	75-27-4	9.2	1	ug/m3	U
cis-1,3-Dichloropropene	10061-01-5	97.3	0.9	ug/m3	U
Tetrachloroethene	127-18-4	195	1	ug/m3	U
trans-1,3-Dichloropropene	10061-02-6	-	0.9	ug/m3	U
1,1,2-Trichloroethane	79-00-5	21.3	1	ug/m3	U
1,2,4-Trichlorobenzene	120-82-1	9.7	4	ug/m3	U
1,4-Dichlorobenzene	106-46-7	3893	1	ug/m3	U
1,2-Dichlorobenzene	95-50-1	973	1	ug/m3	U
Hexachlorobutadiene	87-68-3	15.5	2	ug/m3	U
Ethanol	64-17-5	-	11	ug/m3	
Naphthalene	91-20-3	14.6	3	ug/m3	U
4-Ethyltoluene	622-96-8	-	1	ug/m3	U
1,3,5-Trimethylbenzene	108-67-8	-	1	ug/m3	U
Bromoform	75-25-2	310	2	ug/m3	U
1,1,1,2-Tetrachloroethane	79-34-5	5.9	1	ug/m3	U
1,2,4-Trimethylbenzene	95-63-6	-	1	ug/m3	
1,3-Dichlorobenzene	541-73-1	3893	1	ug/m3	U
2-Chlorotoluene	95-49-8	-	1	ug/m3	U
Carbon disulfide	75-15-0	3407	2	ug/m3	U
Isopropyl alcohol	67-63-0	-	12	ug/m3	U
Acetone	67-64-1	150867	12	ug/m3	U
1,1-Dichloroethene	75-35-4	973	0.8	ug/m3	U
trans-1,2-Dichloroethene	156-60-5	-	0.8	ug/m3	U
Methyl tert-butyl ether	1634-04-4	14600	0.7	ug/m3	U

PAMP METALS, PAHs, VOCs SAMPLES ANALYTICAL RESULTS
 HONEYWELL HIGHLAND PARK
 HIGHLAND PARK, NEW JERSEY

Analyte	CAS Number	Criteria	200-44963 AMS- 5-082218 4:00PM	Units	Qualifier
2-Methyl-2-propanol	75-65-0	-	15	ug/m3	U
3-Chloro-1-propene	107-05-1	-	2	ug/m3	U
Methylene Chloride	75-09-2	2920	5	ug/m3	
Vinyl chloride	75-01-4	487	0.5	ug/m3	U
Butadiene	106-99-0	-	0.8	ug/m3	
Chloromethane	74-87-3	438	1	ug/m3	
1,2-Dichloro-1,1,2,2-tetrafluoroethane	76-14-2	-	1	ug/m3	U
Dichlorodifluoromethane	75-71-8	487	3	ug/m3	
1,1,2-Trichloro-1,2,2-trifluoroethane	76-13-1	146000	2	ug/m3	U
Trichlorofluoromethane	75-69-4	4307	1	ug/m3	
Vinyl bromide	593-60-2	-	0.9	ug/m3	U
Bromomethane	74-83-9	24.3	0.8	ug/m3	U
Chloroethane	75-00-3	48667	1	ug/m3	U
1,2-Dichloroethane	107-06-2	1947	0.8	ug/m3	U
n-Heptane	142-82-5	-	1	ug/m3	
Carbon tetrachloride	56-23-5	195	1	ug/m3	U
Benzene	71-43-2	14.6	3	ug/m3	
Isooctane	540-84-1	-	3	ug/m3	
1,4-Dioxane	123-91-1	146	18	ug/m3	U
Methyl methacrylate	80-62-6	-	2	ug/m3	U
Trichloroethene	79-01-6	9.7	1	ug/m3	U
1,2-Dichloropropane	78-87-5	19.5	0.9	ug/m3	U
cis-1,2-Dichloroethene	156-59-2	-	0.8	ug/m3	U
2-Butanone (MEK)	78-93-3	24333	2	ug/m3	
1,1-Dichloroethane	75-34-3	2433	0.8	ug/m3	U
Hexane	110-54-3	-	2	ug/m3	
Cyclohexane	110-82-7	29200	0.7	ug/m3	U

PAMP METALS, PAHs, VOCs SAMPLES ANALYTICAL RESULTS
 HONEYWELL HIGHLAND PARK
 HIGHLAND PARK, NEW JERSEY

Analyte	CAS Number	Criteria	200-44963 AMS- 5-082218 4:00PM	Units	Qualifier
1,1,1-Trichloroethane	71-55-6	4876	1	ug/m3	U
Chloroform	67-66-3	1460	1	ug/m3	U
Tetrahydrofuran	109-99-9	-	15	ug/m3	U

U -The compound was not detected at the indicated concentration.

J - Data indicates the presence of a compound that meets the identification criteria.

N - The presumptive evidence of a compound. * - LCS or LCSD is outside acceptance limits.

* - RPD of the LCS and LCSD exceeds the control limits.

The concentration given is an approximate value.

-- No criteria available.

BOLD: Analyte detected in sample.

BOLD: Exceedance above the NJDEP Division of Air Quality Toxicity Values for Inhalation Exposure, October 2017.